
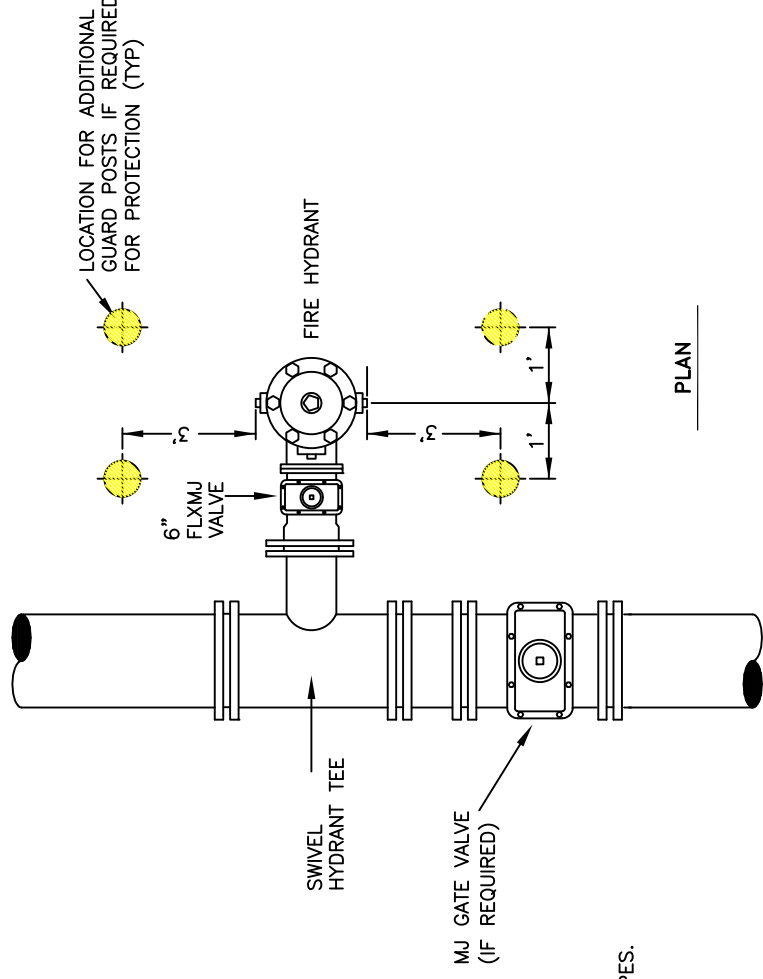


A TYPICAL FIRE HYDRANT

NOT TO SCALE

1. A BREAKAWAY FLANGE IS REQUIRED ON FIRE HYDRANT BASE FLANGE.
2. FIRE HYDRANT LOCATIONS AS SPECIFIED ON PLAN SHEETS.
3. EXCAVATION SHALL CONFORM TO OSHA STANDARDS.
4. ALL FIRE HYDRANTS SHALL BE PLUMB.
5. ALL FIRE HYDRANTS SHALL RECEIVE 3 LAYERS 6 MIL POLYETHYLENE SHEETING AROUND BURIED BARREL PORTION.
6. ORIENT PUMPER NOZZLE PER ENGINEERS DIRECTIONS.

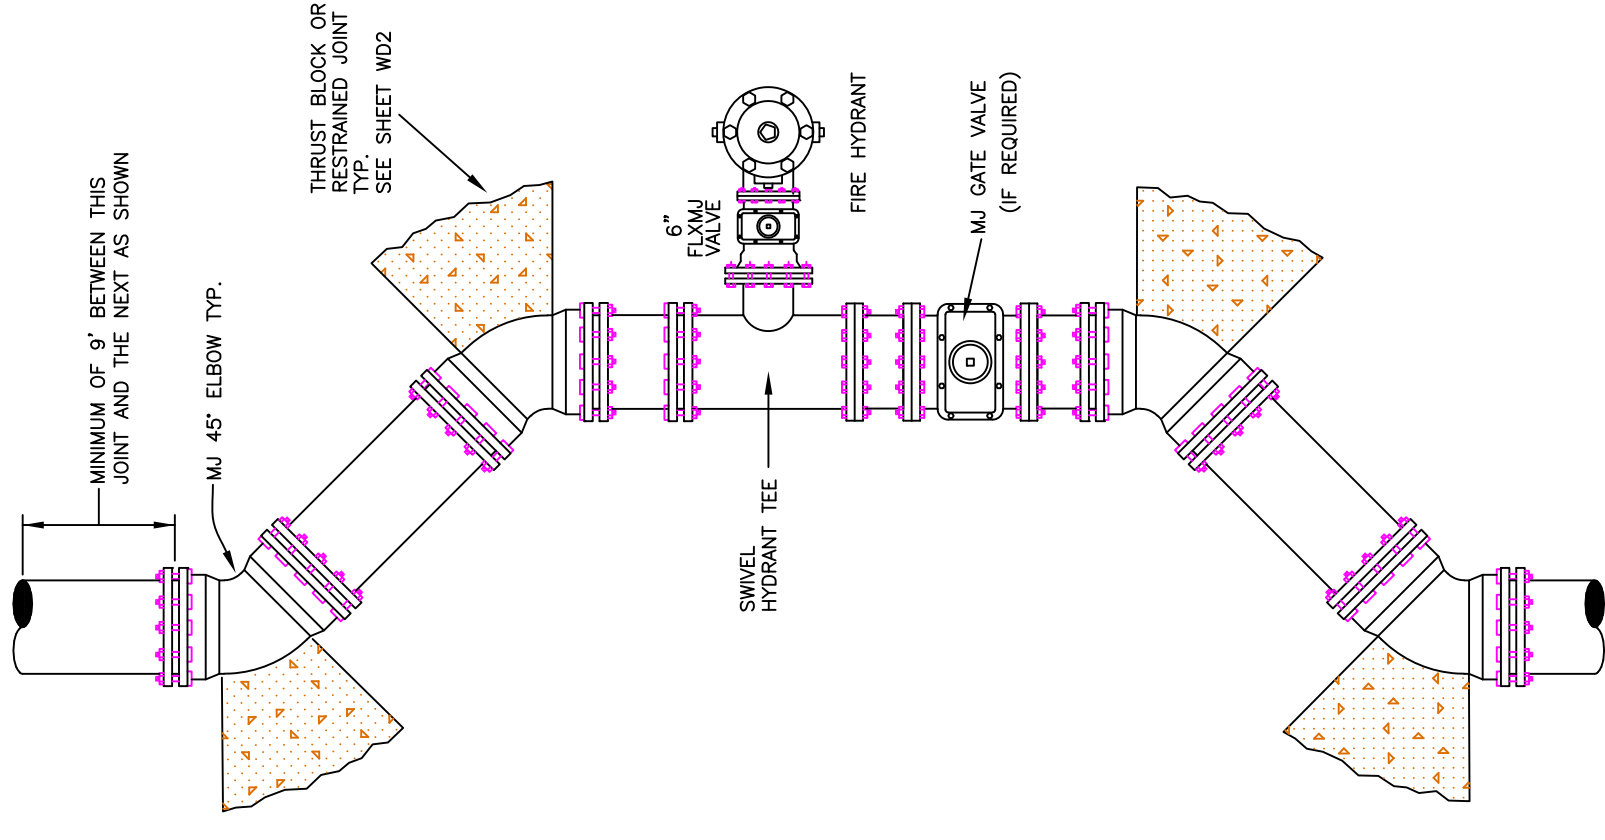

B OFFSET FIRE HYDRANT

NOT TO SCALE

12/16/20	NEW LOGOS	CWH	PLAN SCALE: NOT TO SCALE	DESIGNED	APPROVED
JAN 07	UPDATE	MJB		DRAWN	USA ENGINEER
4/09/02	UPDATE	MJB		CHECKED	MJB
DATE	REVISION	BY		DATE	FILE: STANDARD DETAILS WD1

