

Clarendon Source Water Protection Plan

DuPage County, IL June 2024

红

**ENGINEERING ENTERPRISES, INC.** 



#### **SOURCE WATER PROTECTION PLAN**

Prairie Path Water Company – Clarendon

#### **TABLE OF CONTENTS**

	SECT	TON	PAGE No.					
	<u>JEC1</u>	<u>ION</u>	<u>140.</u>					
1.0	INTR	RODUCTION	1-1					
	1.1	Background	1-1					
2.0	VISIO	VISION STATEMENT						
	2.1	Policy and Commitment to Protecting Source Water	2-1					
	2.2	Reasons to Protect Source Water	2-1					
	2.3	Barriers to Protecting Source Water	2-2					
	2.4	Names of the Individuals Who Developed the Vision Statement	2-3					
3.0	SOU	RCE WATER ASSESSMENT	3-1					
	3.1	Statement of the Importance of Source Water	3-1					
	3.2	List of Water Supplies that Obtain Water from the Community Water Supply	3-2					
	3.3	Delineation of all Sources of Water Used by the Community Water Supply	3-2					
	3.4	Report on the Quality of the Source Water for All Sources of Water	3-4					
	3.5	Report on the Quality of the Finished Water	3-7					
	3.6	Identification of Potential Sources of Contamination to the Source Water	3-9					
	3.7	Analysis of the Source Water's Susceptibility to Contamination	3-10					
	3.8	Explanation of the Community Water Supply's Efforts to Protect Its Source Water	3-12					
4.0	SOU	RCE WATER PROTECTION PLAN OBJECTIVES	4-1					
	4.1	Identified Concerns	4-1					
	4.2	Objectives	4-1					
5.0	ACTI	ION PLAN	5-1					
	5.1	Projects, Programs, and Activities to Meet Objectives	5-1					
	5.2	Schedule for Implementing Projects, Programs, and Activities	5-1					
	5.3	Identification of Necessary Resources to Implement the Plan	5-1					
	5.4	Identification of Potential Problems and Obstacles in Implementing the Plan	5-2					



rabie	<u>es</u>		
3-1	Water Supply Well Information	on	3-3
3-2	Source Water Quality Summa	ary	3-5
3-3	Finished Water Quality Sumr	nary	3-10
3-4	Potential Contaminant Source	e Inventory	3-11
5-1	Source Water Protection Plan	n Schedule	5-3 and 5-4
<u>Exhil</u>	<u>pits</u>		
1-1	Clarendon Municipal Bounda	ry and Water Supply Wells	1-2
3-1	Clarendon CWS Boundary a	nd Water Supply Wells	3-3
3-2	Iron and Sulfate Concentration	on Trend	3-6
3-3	Map of Potential Sources of 0	Contamination	3-10
3-4	Groundwater Susceptibility		3-11
<u>Appe</u>	endices		
Appe	endix A	Source Water Protect	ion Plan Regulations
Appe	endix B		Well Information
Anne	endix C	Representative Source Water Quali	ty Analytical Reports



#### **SECTION 1: INTRODUCTION**

Prairie Path Water Company (PPWC) owns and operates the Clarendon Community Water System (CWS) (IL0435300) according to the rules and regulations of the State of Illinois. On July 26, 2019, the Illinois Pollution Control Board passed new and updated regulations for community water systems including Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan. The purpose of this new requirement is to facilitate protection of source water quality and quantity throughout the State. It requires each community water supply that treats surface or groundwater as a primary or emergency supply of water to develop a Source Water Protection Plan (SWPP). The SWPP must contain the following minimum elements:

- a) a vision statement;
- a source water assessment;
- c) the objectives; and
- d) an action plan.

The specific requirements for each of the elements list above are contained in the regulation, which is included herein as Appendix A. This report is submitted to the Illinois Environmental Protection Agency (IEPA) in fulfillment of the Clarendon CWS's requirement under Subpart C – Source Water Protection Plan.

#### 1.1 Background


The Clarendon CWS is in Downers Grove Township, DuPage County (Exhibit 1-1). The CWS is comprised of a network of various supply, treatment, storage, distribution, and control components. The water system components are specifically designed and operated to provide safe, reliable, and affordable drinking water to the Clarendon CWS water customers. The existing supply consists of two shallow to medium bedrock well designated Well 1 and Well 2. Both Well 1 and Well 2 are cased off through the sand and gravel and upper shallow bedrock geologic systems. Both Well 1 and Well 2 draw from the Alexandrian and Niagaran aquifers which are located within Devonian and Silurian-Dolomite systems in DuPage County.

The pumped water from Wells 1 and 2 flows to Clarendon CWS's Water Treatment Plant (TP01). The raw groundwater is then treated chemically with sodium hypochlorite for bacterial disinfection, fluoridation for dental benefits, and SeaQuest polyphosphate blend for corrosion inhibition and



metal ion sequestration in the distribution system. The water from Wells 1 and 2 are treated to meet drinking water quality standards and is then distributed to Clarendon CWS's residential service population of 1,357 delivered through 271 residential water service connections.

The effectiveness of the system depends on the availability and quality of the water used as the source of water (source water). Significant changes in source water availability or quality often require costly modifications to the water system. Therefore, the Clarendon CWS benefits from Source Water Protection because the program can reduce the risk of source water impairment.

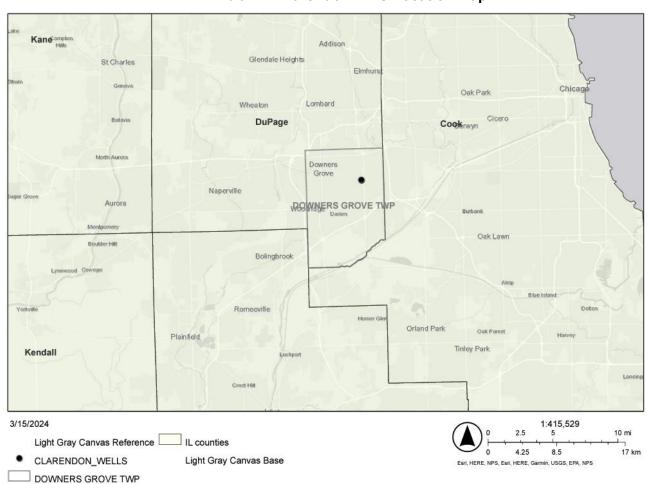

**Exhibit 1-1: Clarendon CWS Location Map** 



#### **SECTION 2: VISION STATEMENT**

This section presents the System's adherence to the requirements of Section 604.310 Vision Statement, which are:

The vision statement must include the following:

- a) the community water supply's policy and commitment to protecting source water;
- b) an explanation of the community water supply's resources to protect source water;
- c) an explanation of the barriers to protecting source water; and
- d) the names of the individuals who developed the vision statement.

#### 2.1 Policy and Commitment to Protecting Source Water

The Prairie Path Water Company - Clarendon CWS policy and commitment to protect source water begins with the following vision statement:

Prairie Path Water Company is committed to Source Water Protection Programs with the purpose of ensuring the safety, integrity and sustainability of our communities' drinking water, for current and future generations to come, all in an effort to help people enjoy a better life and help communities thrive.

#### 2.2 Resources to Protect Source Water

Prairie Path Water Company commits the following resources to protect the source water of the Clarendon CWS:

- Human capital and financial resources to protect our source water and to back our commitment to the preservation of safe and sustainable drinking water.
- Staff time and effort to regularly monitor the well supply, monitor changes in potential sources of contamination, and regularly coordinate with local zoning officials to identify future potential sources of contamination.
- Engaging consultants to update the existing source water protection plan to demonstrate the System's commitment to continually improving the plan with updated



information and incorporating lessons learned through experience.

 Development and continual updates to the Clarendon CWS Emergency Response Plan.

#### 2.3 Barriers to Protecting Source Water

The key to ensuring clean, safe and reliable drinking water is to understand the drinking water supply from the source all the way to the consumer's tap. This knowledge includes understanding the general characteristics of the water and the land surrounding the water source, as well as mapping all the real and potential threats to the water quality. These threats can be natural, such as seasonal droughts or flooding, or created by human activity, such as agriculture, industrial practices, or recreational activities in the watershed. Threats can also arise in the treatment plant or distribution system thanks to operational breakdowns or aging infrastructure.

The multi-barrier approach takes all these threats into account and makes sure there are "barriers" in place to either eliminate them or minimize their impact. It includes selecting the best available source (e.g., lake, river, aquifer) and protecting it from contamination, using effective water treatment, and preventing water quality deterioration in the distribution system. The approach recognizes that while each individual barrier may not be able to completely remove or prevent contamination, and therefore protect public health, together the barriers work to provide greater assurance that the water will be safe to drink over the long term.

By placing integrated barriers from the source to the consumer at the tap, the Clarendon CWS helps protect the population it serves from the risk of contamination and waterborne disease. The System's multiple barrier approach includes:

- Source Water Protection delineation of areas that contribute groundwater to the water supply wells, inventory of existing and future threats also referred to as potential sources of contamination, and management of activities in and around the recharge areas of wells.
- Treatment Systems disinfection to eliminate pathogens that are responsible for waterborne diseases.



- Distribution Systems maintaining adequate pressure within the water distribution system to prohibit inflow of non-potable water, controlling pressure during water main breaks using water system valving, conducting water main repairs quickly, and properly disinfecting water mains before they are placed back into service.
- Monitoring programs 24-hour a day monitoring of the water system using a customized Supervisory Control and Data Acquisition (SCADA) system, frequently collecting, and analyzing water samples, security fencing, and visual inspections of operating facilities.
- Well security PPWC wellheads are located within locked well houses and or gated off areas to protect from vandalism or intentional contamination efforts.
- Operational Response maintaining an emergency response plan, employing certified operators with proper training and experience to operate the water system, commitment of the organization to continuous improvement, and the assistance of outside experts as needed.

#### 2.4 Names of the Individuals Who Developed the Vision Statement

The names of the individuals who developed the Vision Statement are as follows:

- Justin Kersey, PPWC President
- Mike Miller, PPWC Vice President of Operations
- David Hankins, PPWC Safety and Compliance Manager
- Tim Holdeman, Engineering Enterprises, Inc.
- Sydney Shaffer, Engineering Enterprises, Inc.
- Jeniece Neville, Engineering Enterprises, Inc.



#### **SECTION 3: SOURCE WATER ASSESSMENT**

This section presents the System's adherence to the requirements of Section 604.315 Source Water Assessment, which are:

- a) The source water assessment must contain the following information:
  - 1) statement of the importance of the source water;
  - a list of water supplies that obtain water from this community water supply;
  - 3) delineation of all sources of water used by the community water supply, including:
    - A) for surface water, description of the watershed, map of the watershed, and intake locations:
    - B) for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well:
  - 4) a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:
    - A) when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and
    - B) the certified laboratory's results;
  - 5) a report on the quality of the finished water;
  - 6) identification of potential sources of contamination to the source water;
  - 7) analysis of the source water's susceptibility to contamination; and
  - 8) explanation of the community water supply's efforts to protect its source water.

#### 3.1 Statement of the Importance of Source Water

The importance of source water can be conveyed by the importance water plays in the communities it serves. The Clarendon CWS provides water to several residential sites. The Silurian – Dolomite, Niagaran, and Alexandrian aquifers are the primary sources of this water. The Clarendon CWS utilizes two (2) active community water supply wells. The system's water supply wells provides an average of 179,660 gallons per day to a population of approximately 1,357 people (271 service connections) based on the 2020 Census data. Prairie Path Water Company recognizes that no community can exist without a safe, reliable source of drinking water, and protection of that source water is of the utmost importance.



#### 3.2 List of Water Supplies that Obtain Water from the Community Water Supply

The Clarendon CWS currently does not supply water to any Community Water Supplies.

#### 3.3 Delineation of all Sources of Water Used by the Community Water Supply

The Clarendon CWS operates two (2) groundwater wells (Wells 1 and 2). A map showing the location of the water utility service area and water supply wells is shown as Exhibit 3-1. Key information about the wells is listed in Table 3-1, including information required by the SWPP regulation and additional information. Additional well information can be found in Appendix B.

The Illinois Groundwater Protection Act (IGPA) in its first phase established setback zones to prohibit the siting of potential sources of contamination within a number of feet of the wellhead. The minimum setback zone prohibits the siting of primary or secondary sources within 200 ft of the wellhead for shallow aquifers. An optional maximum setback zone of 1,000 feet is allowed to prohibit primary sources of contamination from being sited between the minimum setback and 1,000 radial feet of the well.

In the second phase, the IGPA established the delineation of a wellhead protection area (WHPA) for wells that draw from unconfined aquifers out to a 5-year time-of-travel boundary, although it is not used in this report.



**Table 3-1: Water Supply Well Information** 

	INFO	RMATIO	ADDITIONAL INFORMA	TION				
WELL ID	WELL	WELL	WELL	CASING	MINIMUM			YEAR
NUMBER	NAME	STATUS	DEPTH	LENGTH	SETBACK	AQUIFER	ADDRESS	DRILLED
WL20469	1	Active	325	No Record	200	Silurian-Dolomite, Alexandrian and Niagaran	5795 Holmes Ave, Clarendon Hills, IL 60514	1965
WL20470	2	Active	400	140	200	Silurian-Dolomite, Alexandrian and Niagaran	5795 Holmes Ave, Clarendon Hills, IL 60514	1971

Exhibit 3-1: Clarendon CWS Boundary and Water Supply Well





#### 3.4 Report on The Quality of the Source Water for All Sources of Water

An analysis of the quality of groundwater from the Silurian–Dolomite, Niagaran, and Alexandrian aquifers used by the System as its source water was conducted as part of the Source Water Assessment. Water quality data from groundwater samples from the System's wells collected from 2012 to 2021 is presented in Table 3-2. A select number of analytical results are included in Appendix C.

The concentration of inorganic constituents in the groundwater pumped by the System's wells is summarized and compared to Class 1 Water Quality Standards for Groundwater (35 III. Admin. Code Part 620). Iron has been trending downwards over time but results are not near the Class 1 standard of 5 mg/L. Sulfate has neared the Class 1 Standard of 400 mg/L but concentrations have been steadily decreasing since 2015. Overall, none of the concentrations for any of the measured groundwater constituents are above the Water Quality Standards. All organic compounds including the Volatile Organic Compounds (VOCs) and Synthetic Organic Compounds (SOCs) were reported below the detection limits of each testing method.

Exhibit 3-2 is a graph of iron concentrations from Wells 1 and 2. The graph shows that iron concentrations have been steadily decreasing since 2012 with the latest sample being in June 2021. The second graph in Exhibit 3-2 shows a trend of decreasing sulfate concentrations since April 2015.



**Table 3-2: Source Water Quality Summary** 

	Wells	1 and 2 (WL20469, WL20470)	Class 1 GW Qual. Std.	
	Sand and Grav			
	Silurian Dolom		•	
ifer	Galena-Plattevi	-		
Aquifer	St. Peter Sandst Ironton-Galesville Sa			
	Eau Claire Sands			
	Mt. SimonSands	tone		
	Antimony	(μg/L)	ND	6
	Arsenic	(μg/L)	1.7 - 2.6	10
	Barium	(μg/L)	23 - 25	2000
	Berylium	(μg/L)	ND	4
	Boron	(mg/L)	NR	2
	Cadmium	(μg/L)	ND	5
spu	Chloride	(mg/L)	NR	200
onr	Chromium	(μg/L)	ND	100
шp	Cyanide	(mg/L)	ND	0.2
ပိ	Fluoride	(mg/L)	0.292 - 1.44	4
Inorganic Compounds	Iron	(mg/L)	0.89 - 1.7	5
rga	Manganese	(μg/L)	20 - 25	150
<u>ln</u>	Mercury	(μg/L)	ND	2
	Nickel	(μg/L)	5.4 - 10	100
	Selenium	(μg/L)	ND	50
	Sodium	(mg/L)	44 - 51	
	Sulfate	(mg/L)	260 - 350	400
	Thallium	(μg/L)	ND	2
	Total Dissolved Solids	(mg/L)	ND	1200
als	ALPHA, Gross	pCi/L	0.484 - 2.06	
Radiologicals	Radium-226	pCi/L	0.46 - 0.849	20
diol	Radium-228	pCi/L	0.753 - 1.07	20
	Combined Radium	pCi/L	0.849 - 1.07	
PFAS	PFOA	(ng/L)	ND	
Б	PFOS	(ng/L)	ND	
	SOCs <sup>b</sup>	(μg/L)	ND	
	VOCs <sup>b</sup>	(μg/L)	ND	

#### Notes:

Highlighted value indicates raw water concentration exceeds Class 1 Groundwater Quality Standards. In all cases, treatment is in place to reduce concentration below the standard, and routine monitoring is required.

Highlighted value indicates raw water concentration for parameter that may be approaching the Groundwater Quality Standard or may cause water quality issues. In some cases, treatment is in place to reduce concentration below the standard, and routine monitoring is recommended.


NR = No Record

ND = Non Detect


Results from Safe Drinking Water Information System (SDWIS) Lab
 Sample Numbers EF03776-01, 8041251-01, 5041639-01, 2040853-01,
 22G0322-01, EC02553-01, 8012741-01, 5010962-01, SG40361-01\_02,
 GK04659-01, 22G0322-01, 0111379-01, 18J0801-01\_02, 7101174-01,
 16F1188-01\_03, 4100806-01, SG40361-01\_02, 8012699-01, 3085603001

<sup>&</sup>lt;sup>b</sup> Detailed laboratory results can be found in Appendix C



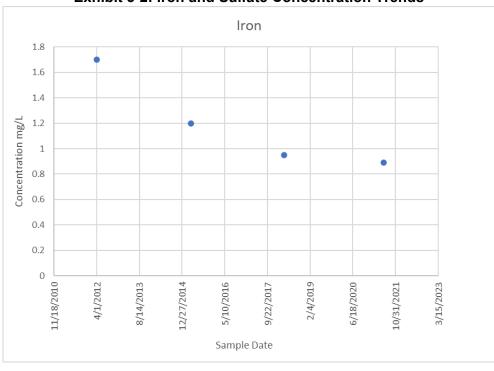

**Exhibit 3-2: Iron and Sulfate Concentration Trends** 

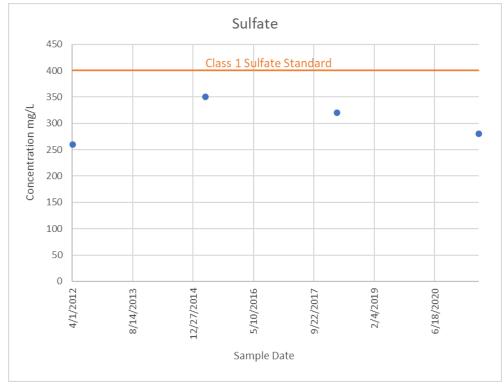



#### 3.5 Report on the Quality of the Finished Water

An analysis of Clarendon's finished water was conducted as part of the Source Water Assessment. Table 3-3 presents a summary of the System's finished water quality based on analytical results from 2019 to 2022. Based on the water quality sampling results shown in Table 3-3, the Clarendon System's finished water does not exceed any primary maximum contaminant levels (MCLs).

Shallow aquifers in much of Northeastern Illinois are experiencing elevated Per- and Polyfluoroalkyl Substances (PFAS) levels. The IEPA has initiated a statewide testing program to test for and monitor PFAS levels of 18 PFAS compounds in water supplies throughout the state but has not yet set enforceable drinking water standards for these compounds. Rather, it has set a health guidance level for six (6) PFAS compounds. The USEPA has recently finalized MCLs for PFOS and PFOA and four (4) other PFAS compounds, although those will not take effect until 2029. The Clarendon System has no detectable PFAS levels in its finished water. The treatment processes applied in the Clarendon CWS do not remove PFAS compounds, therefore the finished water sample results are representative of PFAS compounds in the source water.

The water quality reports in the form of Consumer Confidence Report can be found on the System's website at: <a href="https://www.myutility.us/prairiepathwater/water-safety/water-quality-reports">https://www.myutility.us/prairiepathwater/water-safety/water-quality-reports</a>.



**Table 3-3: Finished Water Quality Summary** 

			Well Effluent <sup>a</sup>	MCLG <sup>b</sup>	MCL <sup>b</sup>
	Sand and Grav				
	Silurian Dolomi	•			
er	Galena-Plattevi				
Aquifer	St. Peter Sandsto				
¥	Ironton-Galesville Sa				
	Eau Claire Sands				
	Mt. SimonSandst				
	Copper	ppm	0.43 - 0.92	1.3	1.3
	Lead	ppb	1.2 - 3		15
	Arsenic	ppb	1.7 - 2.1		10
	Barium	ppm	0.023	2	2
	Iron	ppm	0.61 - 1.9		1
	Manganese	ppb	20 - 22	150	150
locs	Total Nitrate & Nitrite	ppm	NR	10	10
2	Nitrate as N	ppm	0.13	10	10
	Fluoride	ppm	0.292 - 0.81	4	4
	Sulfate		NR	-	-
		ppm			
	Selenium	ppb	NR	50	50
	Sodium	ppm	34.8 - 50		
	Zinc	ppm	0.083	5	5
nts	TTHMs	ppb	7.14 - 11.64		80
cta	HAA5	ppb	2.97 - 7		60
Disinfectants	Chlorine as Cl <sub>2</sub>	ppm	0.43 - 1.17	4	4
Dis	TOC	n/a	NR		
als	Turbidity	NTU	NR		1
Microbials	Turbidity (%<+ 0.3NTU)		NR		≤ 0.3
	Total Coliform Bacteria	#pos/mo	NR	1	
Radiologicals	Comb. Radium	ppm	1.07		5
Radiolo	Gross ALPHA (pCi/L)		NR		15
	SOCs		NR		
	VOCs		NR		
Not					

#### Notes:

Results are from Clarendon 2019 - 2022 Water Quality Reports.

NR = No Record

<sup>b</sup> MCL = Maximum Contaminant Level MCLG=Maximum Contaminant Level Goal

Highlighted value indicates finished water concentration exceeds Primary MCL for parameter. In all cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is required.

Highlighted value indicates finished water concentration exceeds Secondary MCL for parameter. In some cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is recommended.

Highlighted value indicates finished water concentration for parameter that may be approaching Primary or Secondary MCL or may cause water quality issues. In some cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is recommended.

<sup>&</sup>lt;sup>a</sup> The Well Effluent column reflects the water in the distribution system. ND = Non Detect



#### 3.6 Identification of Potential Sources of Contamination to the Source Water

To identify all potential sources of contamination to the source water, both land use contamination and point source contamination were investigated. The proximity of the wells to shallow water bodies was also considered.


The point sources were identified using several hazardous chemical inventory databases. A list of a select number of databases used to determine potential sources of contamination to the System's wells are as follows:

- Agency Facility Inventory and Information Search System (AFIIS) (IEPA)
- Environmental Compliance and History Online (ECHO) (USEPA)
- Tier 2 Hazardous Chemical Database (IEMA Tier 2) (IEMA)
- Illinois Underground Storage Tank Database (IUST) (ISFM)
- Leaking Underground Storage Tank Database (LUST) (IEPA)
- Site Remediation Program Database (SRP) (IEPA)
- National Priority List (NPL)
- Comprehensive Environmental Response, Compensation and Liability Information System (CERCLIS)
- Resource Conservation and Recovery Act Generator List (RCRA LQG)
- Emergency Response Notification System (ERNS)
- Facility Response Plan (FRP)
- FEMA Underground Storage Tank Listing (FEMA UST)
- Clean Construction or Demolition Debris (CCDD)
- Above Ground Storage Tank (AST)

An environmental consultant, A3 Environmental, was engaged to assist in identifying potential sources of contamination within the maximum setback zone of each well. The consultant performed a search of publicly available information from environmental contamination databases belonging to federal, state, tribal, and local sources. These databases contain site specific history and details that aid in identifying if the contaminant is a threat to the source water.



In addition to these databases, the location of oil and gas pipelines and railroad lines were also evaluated. Sites within the well's 200- and 1,000-foot setback zones were considered as possible threats to groundwater quality. As shown in Exhibit 3-3, there were no point source contaminants identified for either well within the setback zones of the well.

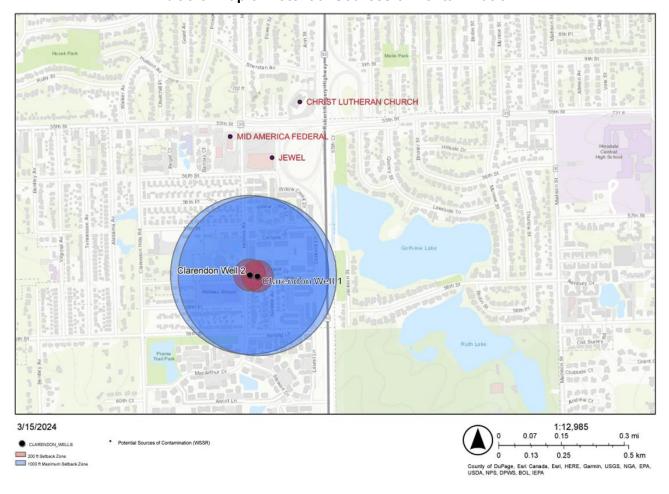

**Exhibit 3-3: Map of Potential Sources of Contamination** 

#### 3.7 Analysis of the Source Water's Susceptibility to Contamination

The wells operated by the Clarendon CWS are shallow-to-medium depth bedrock wells drawing from dolomite and sandstone aquifers. The Silurian-Dolomite aquifer system is integral to many northern Illinois community water supplies including Clarendon. Shallow wells are typically more vulnerable to surface contamination than deep wells because of their lack of bedrock cover due to their proximity to the surface.



Exhibit 3-4 shows the map of geologic susceptibility along with Well 1 and Well 2. The wells are located in an area with a geologic susceptibility rating of E, characterized as impermeable silty or clayey till at least 50-feet thick with no evidence of interbedded sand and gravel. The system's wells are shallow bedrock wells, so they are somewhat susceptible to contamination due to their proximity to the surface, but because they are in the E rating, their susceptibility is somewhat decreased. Therefore, the geologic susceptibility to contamination of the groundwater pumped by these wells is considered moderate.

2/15/2024

CLARENDON\_WELLS

Geologic Susceptibility

CLARENDON\_WELLS

E

1000 ft Maximum Setback Zone

**Exhibit 3-4: Groundwater Susceptibility** 



#### 3.8 Explanation of the Community Water Supply's Efforts to Protect its Source Water

- The Illinois Environmental Protection Act provides a minimum protection zone of 200 feet for Well 1 and Well 2. These minimum protection zones are regulated by the Illinois EPA.
- The System's SCADA system monitors each well 24/7.
- The Clarendon CWS maintains the Emergency Response Plan as contingency planning documents to ensure that, through emergency preparedness, the community minimizes its risk of being without safe and adequate drinking water.
- The following regulations, which contribute to source water protection are currently active in the System:
  - 1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 14.3)
  - 2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)
  - 3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)
  - 4. Stormwater Management (DuPage County code of Ordinances. Chapter 15 Countywide Stormwater and Flood Plain Ordinance)
  - 5. Pollution Control (DuPage County code of Ordinances. Chapter 25 Pollution Control)



#### **SECTION 4: SOURCE WATER PROTECTION PLAN OBJECTIVES**

This section presents the Clarendon CWS's adherence to the requirements of Section 604.320 Source Water Protection Plan Objectives, which are:

The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.

#### 4.1 Identified Concerns

The following concerns regarding the Clarendon CWS's source water were identified based on the source water assessment.

- Impacts of existing and potential future contamination on the Clarendon CWS's source water.
- Impacts of source water contamination on the Clarendon CWS's finished drinking water quality.
- Implications of removing existing and potential future contamination from the Clarendon CWS's source water to meet drinking water standards.
- Identifying and implementing effective programs and activities for protecting the Clarendon CWS's source water.

#### 4.2 Objectives

Given the identified concerns, the Clarendon CWS developed the following SWPP objectives. These objectives provide a framework for the Clarendon CWS's source water protection activities. The specific activities that align with these objectives are outlined in Section 5 of this Plan.

- I. Source Water Characterization / Protection Area Delineation
  - A. Characterize the aquifers used by Clarendon CWS as the source of water supply by identifying groundwater flow patterns, estimating hydraulic properties, and analyzing groundwater quality sampling results.
- II. Potential Contaminant Source and Land Use Inventories



A. Use local, state, and federal data resources to identify the location and nature of potential sources of groundwater contamination and associated land uses within the source water protection areas of Clarendon CWS water supply wells.

#### III. Source Water Protection Management

- A. Public Engagement Engage the community at-large and provide additional opportunities for source water protection stakeholders.
- B. Source Water Monitoring Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.
- C. Contingency Planning Maintain and update existing emergency response plans, particularly as it pertains to groundwater contamination.
- D. Existing Regulatory Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Clarendon CWS's source water protection program.
- E. New Regulatory Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Clarendon CWS's source water protection program.
- F. Planning Actively review, update, and improve all aspects of Clarendon CWS's Source Water Protection Plan.



#### **SECTION 5: ACTION PLAN**

This section presents the Clarendon System's adherence to the requirements of Section 604.325 Action Plan, which are:

In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;
- b) the community water supply's schedule for implementing projects, programs and activities;
- c) an identification of the necessary resources to implement the plan; and
- d) an identification of the potential problems with and obstacles to implementing the plan.

#### 5.1 Projects, Programs, and Activities to Meet Objectives

To meet its Source Water Protection Objectives, the System will continue its current initiatives (as described in Section 3.8), as well as implement the projects, programs, and activities identified below. The entire Action Plan including objectives; projects, programs, and activities; schedule; necessary resources; and potential problems is presented in Table No. 5-1.

#### 5.2 Schedule for Implementing Projects, Programs, and Activities

The schedule for implementing the projects, programs, and activities of the Clarendon System's Source Water Protection Program is presented in Table No. 5-1.

#### 5.3 Identification of Necessary Resources to Implement the Plan

The resources necessary for implementation of the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.

组



#### 5.4 Identification of Potential Problems and Obstacles in Implementing the Plan

The potential problems and obstacles in implementing the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.

组



#### PRAIRIE PATH WATER COMPANY - CLARENDON CWS SOURCE WATER PROTECTION PLAN (July 2024)

Category	Objective	Projects, Programs, and Activities	Schedule	Necessary Resources	Potential Problems
tection		Review delineated maximum setback and recharge zones refine/update as necessary.	July 2029	Staff time	Limited data available
I. Source Water acterization / Protection Area Delineation	<b>A.</b> Characterize the aquifers used by Clarendon CWS as the source of water supply by identifying groundwater flow patterns, estimating hydraulic properties, and analyzing	Collect static and pumping water levels along with well pumping rates; Collect well performance data during well rehabilitation and testing. Analyze these data for anomalies and trends.	Annually	Staff time	Other priorities
l. Sou Characteriz: Area I	groundwater quality sampling results.	3. Designate source water protection areas for each of PPWC's water supply wells. For example: minimum setback zone (200 or 400 feet), maximum setback zone (1,000 feet), or recharge areas.	Completed	N/A	N/A
II. Potential ontaminant Source and Land Use Inventories	A. Use local, state, and federal data resources to identify the location and nature of	PPWC staff conduct visual surveys of activities within the minimum and maximum setback zones of water supply wells.	Monthly	Staff time	None
. Poten minant d Land	potential sources of groundwater contamination and associated land uses within the source water protection areas of	2. Coordinate with jurisdictional authorities to monitor land use changes within the protection areas.	July 2029	Staff time	Cooperation of jurisdictions
Conta an	Clarendon CWS water supply wells.	3. Establish program to engage local Fire Protection Authorities.	July 2029	Staff Time	Interest of jurisdictions
		<ul> <li>1. Public Awareness - Develop and distribute information regarding PPWC source water, including:</li> <li>Newsletters</li> <li>Annual Water Quality Report</li> <li>Bill stuffers / Specialty mailers</li> </ul>	Annually	Staff time	None -WQ Report must be updated for compliance
anagement	<b>A.</b> Public Engagement - Engage the community at-large and provide additional opportunities for source water protection stakeholders.	Public Education - Educate community and property owners on how they can participate in PPWC's source water protection efforts.	July 2029	Staff time	Stakeholder interest
tection M		Public Involvement - Consider creating local source water protection group to promote communication and collaboration on all matters pertaining to source water protection.	July 2029	Staff time	Stakeholder interest
III. Source Water Pro	<b>B.</b> Source Water Monitoring - Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.	Monitor known and emerging contaminants, including the collection of source water samples for current and emerging contaminants and the analysis of these data for anomalies and trends.	As required	Staff time	None - Must be completed for compliance
=	C. Contingency Planning - Maintain and update existing emergency response plans, particularly as it pertains to groundwater contamination.	1. Update Emergency Response Plan (ERP)	Annually	Staff time	Competing priorities

E<sub>4</sub> PAGE 5-3



#### PRAIRIE PATH WATER COMPANY - CLARENDON CWS SOURCE WATER PROTECTION PLAN page 2 (July 2024)

I IVAIIUE I AT	THATER COM ANT CLARENDON ONG COOKCE WATER TROTECTION TEAM page 2	. (July 2027)		
	1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 - 14.3)	Ongoing	Staff time	None - State regulation
D Existing Regulatory - Leverage existing	2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)	Ongoing	Staff time	None - State regulation
local, state, and federal regulations / programs that include source water protection	3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)	Ongoing	Staff time	None - State regs.
CWS's source water protection program.	4. Stormwater Management (DuPage County code of Ordinances. Chapter 15 - Countywide Stormwater and Flood Plain Ordinance)	Ongoing	Staff time	None - County program
	5. Pollution Control (DuPage County code of Ordinances. Chapter 25 – Pollution Control)	Ongoing	Staff time	None - County program
E. New Regulatory - Consider additional	Overlay Ordinance establishing a 1,000-foot maximum setback zone.	July 2029	Staff time	Cooperation of local jurisdiction
source water and incorporate those that are applicable into Clarendon CWS's source water	2. Signage at wells and water treatment facilities	July 2029	Staff time, cost of signs	None
protection program.	3. Land acquisition / Conservation easements	July 2029	Staff time, funding	Availability of land
	Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.	July 2029	Staff time	Competing priorities
F. Planning - Actively review, update, and improve all aspects of Clarendon CWS's	2. Support County Water Sustainability efforts (if applicable).	July 2029	Staff time	Existence of such programs
Source Water Protection Plan.	3. Periodic review and updating of the Source Water Protection Plan Vision statement, Source Water Assessment, Objectives, and Action Plan with input from external stakeholders.	July 2029	Staff time / Consultant	None -required for compliance
	D. Existing Regulatory - Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Clarendon CWS's source water protection program.  E. New Regulatory - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Clarendon CWS's source water protection program.  F. Planning - Actively review, update, and	D. Existing Regulatory - Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Clarendon CWS's source water protection program.  E. New Regulatory - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Clarendon CWS's source water and incorporate those that are applicable into Clarendon CWS's source water protection program.  F. Planning - Actively review, update, and improve all aspects of Clarendon CWS's Source Water Protection Plan.  1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 - 14.3)  2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)  3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)  4. Stormwater Management (DuPage County code of Ordinances. Chapter 15 - Countywide Stormwater and Flood Plain Ordinance)  5. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  1. Overlay Ordinance establishing a 1,000-foot maximum setback zone.  2. Signage at wells and water treatment facilities  3. Land acquisition / Conservation easements  1. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.  2. Support County Water Sustainability efforts (if applicable).  3. Periodic review and updating of the Source Water Protection Plan Vision statement, Source Water	2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)  Ongoing  2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)  Ongoing  3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)  Ongoing  4. Stormwater Management (DuPage County code of Ordinances. Chapter 15 - Countywide Stormwater and Flood Plain Ordinance)  E. New Regulatory - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Clarendon CWS's source water protection program.  E. New Regulatory - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Clarendon CWS's source water protection program.  1. Overlay Ordinance establishing a 1,000-foot maximum setback zone.  2. Signage at wells and water treatment facilities  July 2029  1. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.  July 2029  1. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.  July 2029  2. Support County Water Sustainability efforts (if applicable).  July 2029  3. Periodic review and updating of the Source Water Protection Plan Vision statement, Source Water	D. Existing Regulatory - Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Clarendon CWS's source water protection program.  1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 - 14.3)  2. Well Construction and Pump Installation (77 ILL Admin Code Part 915, 920 and 925)  3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)  4. Stormwater Management (DuPage County code of Ordinances. Chapter 15 - Countywide Stormwater and Flood Plain Ordinance)  5. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  6. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  7. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  8. Staff time  9. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  9. Pollution Control (DuPage County code of Ordinances. Chapter 25 - Pollution Control)  10. Overlay Ordinance establishing a 1,000-foot maximum setback zone.  11. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources  12. Signage at wells and water treatment facilities  13. Land acquisition / Conservation easements  14. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources  15. Polanning - Actively review, update, and improve all aspects of Clarendon CWS's Source Water Protection Plan.  26. Support County Water Sustainability efforts (if applicable).  27. Support County Water Sustainability efforts (if applicable).  38. Deriodic review and updating of the Source Water Protection Plan Vision statement, Source Water

E<sub>4</sub> PAGE 5-4



# APPENDIX A

# Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan

#### TITLE 35: ENVIRONMENTAL PROTECTION SUBTITLE F: PUBLIC WATER SUPPLIES CHAPTER I: POLLUTION CONTROL BOARD

#### PART 604 DESIGN, OPERATION AND MAINTENANCE CRITERIA

#### SUBPART C: SOURCE WATER PROTECTION PLAN

#### Section 604.300 Purpose

The purpose of the following requirements is to facilitate protection of source water quality and quantity.

#### Section 604.305 Source Water Protection Plan Requirement and Contents

Each community water supply that treats surface or groundwater as a primary or emergency supply of water must develop a source water protection plan that contains the following minimum elements:

- a) a vision statement as set forth in Section 604.310;
- b) a source water assessment as set forth in Section 604.315;
- c) the objectives set forth in Section 604.320; and
- d) an action plan as set forth in Section 604.325.

#### Section 604.310 Vision Statement

The vision statement must include the following:

- a) the community water supply's policy and commitment to protecting source water;
- b) an explanation of the community water supply's resources to protect source water;
- c) an explanation of the barriers to protecting source water; and
- d) the names of the individuals who developed the vision statement.

#### **Section 604.315 Source Water Assessment**

- a) The source water assessment must contain the following information:
  - 1) statement of the importance of the source water;

- 2) a list of water supplies that obtain water from this community water supply;
- delineation of all sources of water used by the community water supply, including:
  - A) for surface water, description of the watershed, map of the watershed, and intake locations;
  - B) for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well;
- 4) a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:
  - A) when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and
  - B) the certified laboratory's results;
- 5) a report on the quality of the finished water;
- 6) identification of potential sources of contamination to the source water;
- 7) analysis of the source water's susceptibility to contamination; and
- 8) explanation of the community water supply's efforts to protect its source water.
- b) Upon request, the Agency will provide technical assistance to a community water supply in conducting the source water assessment.
- b) A community water supply may use a Source Water Assessment Program Fact Sheet prepared by the Agency to fulfill the requirements of this Section.

#### Section 604.320 Source Water Protection Plan Objectives

The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water

assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.

#### Section 604.325 Action Plan

In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;
- c) the community water supply's schedule for implementing projects, programs and activities:
- c) an identification of the necessary resources to implement the plan; and
- d) an identification of the potential problems with and obstacles to implementing the plan.

#### Section 604.330 Submission

- a) A community water supply that first commenced construction after July 26, 2019, must develop and submit a source water protection plan simultaneously with the construction permit application.
- b) A community water supply in existence as of July 26, 2019, must develop and submit to the Agency for approval a source water protection plan within the following time frame after July 26, 2019:
  - 1) within 3 years, for a community water supply serving a population greater than 50,000 persons;
  - 2) within 4 years, for a community water supply serving a population of greater than 3,000 but less than or equal to 49,999 persons; or
  - 3) within 5 years, for a community water supply serving a population of less than or equal to 2,999 persons.
- d) An existing community water supply that anticipates using a new source of water for its supply must develop and submit a revised source water protection plan simultaneously with the construction permit application.

#### Section 604.335 Agency Approval

The Agency, not later than 45 days after the receipt of the source water protection plan, will either approve or disapprove the plan. If the Agency takes no action within the 45 days, the community water supply may deem the plan approved. A community water supply may waive the requirement that the Agency take an action within the 45 days by so advising the Agency in writing.

#### **Section 604.340 Evaluation and Revision**

The community water supply must review, and revise as necessary, its source water protection plan no less frequently than every five years. If the community water supply revises its source water protection plan, it must submit the plan to the Agency for approval under Section 604.335.



# APPENDIX B

### Well Information

#### $_{\mathtt{Page}-1}$ ILLINOIS STATE GEOLOGICAL SURVEY

Water Well	Тор	Bottom
Total Depth		32
Driller's Log filed		32

Permit Date: Permit #:

COMPANY Neely, George
FARM Clarendon Wtr Co

DATE DRILLED June 1, 1965 NO.

ELEVATION 730GL COUNTY NO. 01685

**LOCATION** 1900'N line, 1400'W line of section **LATITUDE** 41.783461 **LONGITUDE** -87.950297

COUNTY DuPage API 120430168500 14 - 38N - 11E

 $_{\mathtt{Page}-1}$  ILLINOIS STATE GEOLOGICAL SURVEY

Water Well for Business	Тор	Bottom
no record	0	400
Total Depth		400
Casing: " CASING from 3' to 140'		

Permit Date: Permit #:

COMPANY

FARM Utl Inc Clarendon Wtr Co

DATE DRILLED January 1, 1971 NO. 2

ELEVATION 0 COUNTY NO. 30848

LOCATION NW SE NW

**LATITUDE** 41.784167 **LONGITUDE** -87.949423

COUNTY DuPage API 120433084800 14 - 38N - 11E



# APPENDIX C

# Representative Source Water Quality Analytical Lab Reports

#### Clarendon Water System

			All resi	ults reported a	ıs Nanograms pe	r liter(ng/L)	
Sampling	Location	Date Sampled	PFOS	PFOA	Combined PFOS + PFOA	EPA Health Advisory Level	Result Below Health Advisory Level?
Entry Poi	nt Well 1	5/19/2020	ND	ND	ND	70	Υ
Entry Poi	nt Well 2	5/19/2020	ND	ND	ND	70	Υ

- **PFOS** Perfluorooctane Sulfonate
- PFOA Perfluorooctanoic Acid
- Health Advisory Level (HAL) To provide Americans, including the most sensitive populations, with a margin of
  protection from a lifetime of exposure to PFOA and PFOS from drinking water, EPA established the health advisory
  levels at 70 parts per trillion.
- **Ng/L** Nanograms per liter(ng/L) which equals Parts per trillion (ppt) One part per trillion corresponds to one minute in 2,000,000 years, or a single penny in \$10,000,000,000.
- **ND (No Detect)** Laboratory analysis indicates that the constituent is not present. 2.0 ng/L is the minimum level the lab is reporting a detection for these parameters. The ND (No Detect) represented in the table is indicating there was no detection.

## **Chem/Rad Sample Results**

Return Links

<u>Chem/Rad</u> <u>Samples</u>

**Analyte List** 

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name : PRAIRIE PATH WATER COMPANY-CLARENDON State Type : C

Principal County
Served:

DU PAGE
Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 EF03776-01
 Collection Date :
 06-17-2021

This list displays sample/results of all non-microbial analytes

(TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Water Systems	Analyte Code	Analyte Name	Method Code	Less than Indicator	Tyne		Concentration level	0	Monitoring Period End Date
Water System	1005	ARSENIC	200.8			0	2.1 UG/L	01-01-2020	12-31-2022
Search		BARIUM	200.8			0	23 UG/L	01-01-2020	12-31-2022
·	1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
County Map	1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2022
	1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2022
Glossary	1025	FLUORIDE	4500F-C			0	0.81 MG/L	01-01-2020	12-31-2022
	1028	IRON	200.7			0	0.89 MG/L	04-01-2021	06-30-2021
	1032	MANGANESE	200.8			0	22 UG/L	01-01-2020	12-31-2022
	1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022
	1036	NICKEL	200.8			0	5.4 UG/L	01-01-2020	12-31-2022
	1045	SELENIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
	1052	SODIUM	200.7			0	50 MG/L	01-01-2020	12-31-2022
	1055	SULFATE	300.0			0	280 MG/L	01-01-2020	12-31-2022
	1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2020	12-31-2022
	1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
	1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
	1095	ZINC	200.8			0	83 UG/L	01-01-2020	12-31-2022

## **Chem/Rad Sample Results**

Return Links

<u>Chem/Rad</u> <u>Samples</u>

Analyte List

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name : PRAIRIE PATH WATER COMPANY-CLARENDON State Type : C

Principal County
Served:

DU PAGE
Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 8041251-01
 Collection Date :
 04-04-2018

This list displays sample/results of all non-microbial analytes

(TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Water	Analyte	Analyte	Method	Less	Level	Reporting	Concentration	0	Monitoring
Systems	Code	Name	Code	than		1 0	level	Period	Period End
	Code	Ivallie	Code	Indicator	Type	Level	level	<b>Begin Date</b>	Date
Water System	1005	ARSENIC	200.8			0	1.7 UG/L	01-01-2017	12-31-2019
Search	1010	BARIUM	200.8			0	23 UG/L	01-01-2017	12-31-2019
	1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2019
County Map	1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2019
, ,	1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2017	12-31-2019
Glossary	1025	FLUORIDE	4500F-C			0	0.292 MG/L	01-01-2017	12-31-2019
	1028	IRON	200.7			0	0.95 MG/L	04-01-2018	06-30-2018
	1032	MANGANESE	200.8			0	20 UG/L	01-01-2017	12-31-2019
	1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2017	12-31-2019
	1036	NICKEL	200.8			0	7.4 UG/L	01-01-2017	12-31-2019
	1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2019
	1052	SODIUM	200.7			0	46 MG/L	01-01-2017	12-31-2019
	1055	SULFATE	300.0			0	320 MG/L	01-01-2017	12-31-2019
	1 10 /4	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2017	12-31-2019
	1 107/5	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2019
	1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2019
	1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2017	12-31-2019

## **Chem/Rad Sample Results**

Return Links

<u>Chem/Rad</u> <u>Samples</u>

Analyte List

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name : PRAIRIE PATH WATER COMPANY-CLARENDON State Type : C

Principal County

DU PAGE

Primary Source: GW

 Served :
 A

 Status :
 A

 Activity Date :
 01-01-1965

 Collection Date :
 04-07-2015

This list displays sample/results of all non-microbial analytes

(TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Water Systems	Analyte Code	Analyte Name	Method Code	Less than Indicator	Tyno		Concentration level	0	Monitoring Period End Date
Water System	1005	ARSENIC	200.8			0	2.1 UG/L	01-01-2014	12-31-2016
Search		BARIUM	200.8			0	25 UG/L	01-01-2014	12-31-2016
	1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
County Map	1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2016
Glossary	1024	CYANIDE	4500CN- C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2016
G105541 y	1025	FLUORIDE	4500F-C			0	1.44 MG/L	01-01-2014	12-31-2016
	1028	IRON	200.7			0	1.2 MG/L	04-01-2015	06-30-2015
	1032	MANGANESE	200.8			0	25 UG/L	01-01-2014	12-31-2016
	1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
	1036	NICKEL	200.8			0	10 UG/L	01-01-2014	12-31-2016
	1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2016
	1052	SODIUM	200.7			0	44 MG/L	01-01-2014	12-31-2016
	1055	SULFATE	300.0			0	350 MG/L	01-01-2014	12-31-2016
	1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2016
	1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
	1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
	1095	ZINC	200.8			0	13 UG/L	01-01-2014	12-31-2016

## **Chem/Rad Sample Results**

Return Links

<u>Chem/Rad</u> <u>Samples</u>

Analyte List

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name : PRAIRIE PATH WATER COMPANY-CLARENDON State Type : C

Principal County
Served:

DU PAGE
Primary Source: GW

 Status:
 A

 Lab Sample No.:
 2040853-01

 Activity Date:
 01-01-1965

 Collection Date:
 04-03-2012

This list displays sample/results of all non-microbial analytes

(TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for

Microbial Analytes are not included.

Water	Analyte	Analyte	Method	Less	Level	Reporting	Concentration		Monitoring
<u>Systems</u>	Code	Name	Code	than Indicator	Type	Level	level	Period Begin Date	Period End Date
Water System	1005	ARSENIC	200.8			0	2.6 UG/L	01-01-2011	12-31-2013
Search		BARIUM	200.8			0	24 UG/L	01-01-2011	12-31-2013
	1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2011	12-31-2013
County Map	1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2011	12-31-2013
Glossary	1024	CYANIDE	4500CN- C	Y	MRL	0.2 MG/L		01-01-2011	12-31-2013
SIODSWI J	1025	FLUORIDE	300.0			0	0.902 MG/L	01-01-2011	12-31-2013
	1028	IRON	200.7			0	1.7 MG/L	04-01-2012	06-30-2012
	1032	MANGANESE	200.8			0	24 UG/L	01-01-2011	12-31-2013
	1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2011	12-31-2013
	1036	NICKEL	200.8			0	9.4 UG/L	01-01-2011	12-31-2013
	1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2011	12-31-2013
	1052	SODIUM	200.7			0	51 MG/L	01-01-2011	12-31-2013
	1055	SULFATE	300.0			0	260 MG/L	01-01-2011	12-31-2013
	1 10/4	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2011	12-31-2013
	1111/5	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2011	12-31-2013
	I IIIX5	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2011	12-31-2013
	1095	ZINC	200.8			0	46 UG/L	01-01-2011	12-31-2013

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type:

C

GW

PRAIRIE PATH WATER COMPANY-CLARENDON

State Type:

C

Chem/Rad

**DU PAGE Principal County Served:** Status:

Water System Name:

**Primary Source: Activity Date:** 

01-01-1965

Samples

Α 22G0322-01 Lab Sample No. :

07-11-2022 **Collection Date:** 

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

**Analyte** List

Water System Detail

Water Systems

Water System Search

County Map

	Analyte		Method	Less	Level	Reporting	Concentration	Monitoring	
	Code	<b>Analyte Name</b>	Code	than	Type		level	Perioa	Period End
	Coue		Code	Indicator	Type	Level	ievei	<b>Begin Date</b>	Date
	1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
	1003	NITROGEN-AMMONIA AS (N)	350.1			0	0.76 MG/L		
	1005	ARSENIC	200.8			0	2.09 UG/L		
Ì	1010	BARIUM	200.8			0	25.7 UG/L		
Ì	1015	CADMIUM	200.8	Y	MRL	3 UG/L			
- 1	1017	CHLORIDE	300.0			0	64.1 MG/L		
- 1	1019	CALCIUM	200.7			0	182000 UG/L		
- 1	1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
- 1	1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
7	1024	CYANIDE	335.4	Y	MRL	0.2 MG/L			
- 1	1025	FLUORIDE	300.0			0	0.24 MG/L		
- 1	1028	IRON	200.7			0	781 UG/L		
ry	1030	LEAD	200.8	Y	MRL	5 UG/L			
- 1	1031	MAGNESIUM	200.7			0	54200 UG/L		
- 1	1032	MANGANESE	200.8			0	24.3 UG/L		
- 1	1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
- 1	1036	NICKEL	200.8	Y	MRL	25 UG/L			
- 1	1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
- 1		POTASSIUM	200.7			0	4650 UG/L		
- 1		SELENIUM	200.8	Y	MRL	2 UG/L			
- 1		SILICA	200.7			0	14600 UG/L		
- 1		SILVER	200.8	Y	MRL	10 UG/L			
- 1	1051	STRONTIUM	200.7			0	1770 UG/L		
- 1	1052	SODIUM	200.7			0	37900 UG/L		
- 1	1055	SULFATE	300.0			0	285 MG/L		
	1064	CONDUCTIVITY @ 25 C UMHOS/CM	9911			0	1248 SU		
- 1	1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
- 1	1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
- 1	1079	BORON, TOTAL	200.7			0	258 UG/L		
- 1	1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
- 1	1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
- 1	1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
- 1	1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
- 1	1093	PHOSPHORUS, TOTAL	365.1			0	0.008 MG/L		
- 1	1095	ZINC	200.8	Y	MRL	100 UG/L			
- 1	1915	HARDNESS, TOTAL (AS CACO3)	200.7			0	677000 UG/L		
	1926	PH FIELD	9911			0	6.62 SU		
	1927	ALKALINITY, TOTAL	2320B			0	360 MG/L		
	1930	TDS	2540C			0	1050 MG/L		
	1996	TEMPERATURE (CENTIGRADE)	9911			0	12.59 SU		
	2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
	2010	BHC-GAMMA	525.2	Y	MRL	0.02 UG/L			

2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		1	
	TOXAPHENE	525.2	Y	MRL	1 UG/L			
	ACETOCHLOR	525.2	Y	MRL	1 UG/L			
	DALAPON	515.4	Y	MRL	5 UG/L			
-			Y					
-	DI(2-ETHYLHEXYL) ADIPATE	525.2		MRL	0.6 UG/L			
	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
-	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
	PICLORAM	515.4	Y	MRL	1 UG/L			
	DINOSEB	515.4	Y	MRL	1 UG/L			
	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
-	METOLACHLOR	525.2	Y	MRL	0.25 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L			
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2055	TRIFLURALIN	525.2	Y	MRL	0.05 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
-	DCPA	525.2	Y	MRL	0.5 UG/L		1	
	2,4-D	515.4	Y	MRL	1 UG/L			
	DCPA MONO/DI-ACID							
2108	DEGRADATES	515.4	Y	MRL	0.5 UG/L			
2110	2,4,5-TP	515.4	Y	MRL	1 UG/L			
2251	METHYL TERT-BUTYL ETHER	524.3	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L			
	PENTACHLOROPHENOL	515.4	Y	MRL	0.4 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2378	1,2,4-TRICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2380	CIS-1,2-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
	DICAMBA	515.4	Y	MRL	0.25 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
	PHENOLS	420.4	-	WITCE	0	11.3 UG/L		
2955	XYLENES, TOTAL	524.3	Y	MRL	0.5 UG/L	11.5 CG/E		
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			
2964	DICHLOROMETHANE	524.3	Y	MRL	0.2 UG/L 0.5 UG/L			
2968	O-DICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
-				1				
<u> </u>	P-DICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.3	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2979	TRANS-1,2-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.3	Y	MRL	0.5 UG/L		<b> </b>	
2981	1,1,1-TRICHLOROETHANE	524.3	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.3	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.3	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.3	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2990	BENZENE	524.3	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.3	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.3	Y	MRL	0.5 UG/L			
2996	STYRENE	524.3	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING	9911			0	20 SU		
0002	(MIN)				U			
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	230 SU		
9998	OXIDATION-REDUCTION	9911			0	2 SU		
	POTENTIAL (EH)				-			

## **Drinking Water Branch**

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type :

Water System Name: PRAIRIE PATH WATER COMPANY-CLARENDON State Type: C

Principal County Served :DU PAGEPrimary Source :GWStatus :AActivity Date :01-01-1965Lab Sample No. :EC02553-01Collection Date :03-11-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

<u>Analyte</u> <u>List</u>

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

County Map

Glossary

	1		T	1			В.Л	7b.//F * 4 *
Analyte	A I . 4 . 76 T	Method	Less	Level	Reporting	Concentration		Monitoring
Code	Analyte Name	Code	than	Type		level	Period	Period End
1020	Thou	200.7	Indicator		0	1 1/6/7	Begin Date	
	IRON	200.7	37	MDI	0	1 MG/L	01-01-2021	03-31-2021
	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2022
	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2022
2015	METHOXYCHLOR	525.2		MRL	0.1 UG/L		01-01-2020	12-31-2022
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2022
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L		01 01 000	12 21 2022
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2022
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2022
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2022
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2022
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2022
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2020	12-31-2022
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2022
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2022
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2022
2042	HEXACHLOROCYCLOPENTADIENE		Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2022
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2020	12-31-2022
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022
	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2022
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2022
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2022
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2022
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2022
	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2022
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2022
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2022
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2022
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L		01-01-2020	12-31-2022
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2022
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2022
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2022
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300

Federal Type : C

Water System Name :

PRAIRIE PATH WATER COMPANY-CLARENDON

State Type : C

Chem/Rad Samples DU PAGE

Primary Source : GW

 Status :
 A

 Lab Sample No. :
 8012741-01

**Principal County Served:** 

**Activity Date :** 01-01-1965 **Collection Date :** 01-17-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Water System Detail

Water Systems

Water System Search

County Map

Glossary

			Less				Monitoring	Monitoring
Analyte	<b>Analyte Name</b>	Method	than			Concentration		Period End
Code		Code	Indicator	Type	Level	level	Begin Date	
1028	IRON	200.7			0	1.1 MG/L	01-01-2018	
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2019
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2017	12-31-2019
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2017	12-31-2019
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2017	12-31-2019
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2017	12-31-2019
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2017	12-31-2019
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2017	12-31-2019
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2017	12-31-2019
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2019
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2019
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2017	12-31-2019
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2017	12-31-2019
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2019
	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2017	12-31-2019
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2017	12-31-2019
	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2019
	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2019
	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2019
	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2017	12-31-2019
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2019
	DICAMBA	515.3	Y	MRL	0.3 UG/L			
	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2019
	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2017	12-31-2019
	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2017	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2019

## **Drinking Water Branch**

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type :

Water System Name: PRAIRIE PATH WATER COMPANY-CLARENDON State Type: C

Principal County Served :DU PAGEPrimary Source :GWStatus :AActivity Date :01-01-1965Lab Sample No. :5010962-01Collection Date :01-06-2015

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE  $\Leftrightarrow$  MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

County Map

Glossary

Analyte		Method	Less	Lovol	Donorting	Concentration		Monitoring
Code	Analyte Name	Code	than	Type		level	Period	Period End
Coue		Code	Indicator	Type	Level	level	<b>Begin Date</b>	Date
1028	IRON	200.7			0	1.1 MG/L	01-01-2015	03-31-2015
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2016
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2016
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2014	12-31-2016
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2014	12-31-2016
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2014	12-31-2016
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2016
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2014	12-31-2016
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2014	12-31-2016
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2014	12-31-2016
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2016
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2016
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2016
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300

Α

Federal Type:

C

GW

Water System Name:

Status:

**Principal County Served:** 

PRAIRIE PATH WATER COMPANY-CLARENDON

State Type:

C

Chem/Rad

**DU PAGE** 

**Primary Source: Activity Date:** 

01-01-1965 07-07-2014

Samples

SG40361-01 02 Lab Sample No. : **Collection Date:** This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE CODE <> MOR)

associated to the selected sample. Results for Microbial Analytes are not included.

**Analyte** List

Water System Detail

Water Systems

Water System Search

County Map

	10 4			Less		TD (*		Monitoring	Monitoring
	nalyte	<b>Analyte Name</b>	Method	than			Concentration	0	Period End
- 1	Code	•	Code	Indicator	Type	Level	level	<b>Begin Date</b>	Date
	1025	FLUORIDE	4500F-C	N		0	0.271 MG/L		
	2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
	2010	BHC-GAMMA	525.2	Y	MRL	0.02 UG/L			
	2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
	2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
	2027	ACETOCHLOR	525.2	Y	MRL	1 UG/L			
	2031	DALAPON	515.1	Y	MRL	5 UG/L			
	2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
	2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
7	2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
	2040	PICLORAM	515.1	Y	MRL	1 UG/L			
	2041	DINOSEB	515.1	Y	MRL	1 UG/L			
<u>y</u>	2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
	2045	METOLACHLOR	525.2	Y	MRL	0.25 UG/L			
	2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L			
	2051	LASSO	525.2	Y	MRL	0.2 UG/L			
	2054	CYANAZINE	525.2	N		0	0.00 UG/L		
	2055	TRIFLURALIN	525.2	Y	MRL	0.05 UG/L			
	2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
	2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
	2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
	2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
	2098	BROMACIL	525.2	Y	MRL	1 UG/L			
	2105	2,4-D	515.1	Y	MRL	1 UG/L			
	2110	2,4,5-TP	515.1	Y	MRL	1 UG/L			
	2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
	2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
	2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L			
	2326	PENTACHLOROPHENOL	515.1	Y	MRL	0.4 UG/L			
	2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
	2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
	2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
	2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.4 UG/L			
	2440	DICAMBA	515.1	Y	MRL	0.25 UG/L			
	2595	METRIBUZIN	525.2	Y	MRL	0.1 UG/L			
	2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
	2910	PHENOLS	420.4	Y	MRL	10 UG/L			
	2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
Ī	2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			
Ī	2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
Ī	2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
T	2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			

2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		
9915	ACIFLUORFEN	515.1	Y	MRL	0.5 UG/L		

**Total Number of Records Fetched = 58** 

## **Drinking Water Branch**

## **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type:

PRAIRIE PATH WATER COMPANYState Type: C Water System Name: **CLARENDON** 

Principal County Served: DU PAGE **Primary Source:** GW 01-01-1965 **Activity Date:** Status:

GK04659-01 11-30-2023 Lab Sample No. : **Collection Date:** 

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

<u>Analyte</u> List

Samples

Chem/Rad

Water System Detail

Water Systems

Water **System** Search

County Map

Glossary

	1		Г _	1	Г	T	L	L
Analyte		Method	Less	Level	Reporting	Concentration	Monitoring	_
Code	Analyte Name	Code	than	Type	1 0	level	Period	Period End
			Indicator	-JP-			<b>Begin Date</b>	
1028	IRON	200.7			0	0.95 MG/L	10-01-2023	12-31-2023
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type:

C

GW

Water System Name:

PRAIRIE PATH WATER COMPANY-CLARENDON

State Type:

C

Chem/Rad

**Principal County Served: DU PAGE** Status:

**Primary Source: Activity Date:** 

01-01-1965 07-11-2022

Samples

Α 22G0322-01 Lab Sample No. :

**Collection Date:** 

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

**Analyte** List

Water System Detail

Water Systems

Water System Search

County Map

	nalyte		Method	Less	Lovol	Donorting	Concentration	Monitoring	Monitoring
	nary te Code	<b>Analyte Name</b>	Code	than		Level	level	Period	<b>Period End</b>
'	Coue		Code	Indicator	Type	Level	ievei	<b>Begin Date</b>	Date
	1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
	1003	NITROGEN-AMMONIA AS (N)	350.1			0	0.76 MG/L		
	1005	ARSENIC	200.8			0	2.09 UG/L		
	1010	BARIUM	200.8			0	25.7 UG/L		
	1015	CADMIUM	200.8	Y	MRL	3 UG/L			
	1017	CHLORIDE	300.0			0	64.1 MG/L		
	1019	CALCIUM	200.7			0	182000 UG/L		
	1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
	1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
	1024	CYANIDE	335.4	Y	MRL	0.2 MG/L			
	1025	FLUORIDE	300.0			0	0.24 MG/L		
	1028	IRON	200.7			0	781 UG/L		
<u>/</u>	1030	LEAD	200.8	Y	MRL	5 UG/L			
	1031	MAGNESIUM	200.7			0	54200 UG/L		
	1032	MANGANESE	200.8			0	24.3 UG/L		
	1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
	1036	NICKEL	200.8	Y	MRL	25 UG/L			
	1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
	1042	POTASSIUM	200.7			0	4650 UG/L		
	1045	SELENIUM	200.8	Y	MRL	2 UG/L			
	1049	SILICA	200.7			0	14600 UG/L		
L	1050	SILVER	200.8	Y	MRL	10 UG/L			
	1051	STRONTIUM	200.7			0	1770 UG/L		
	1052	SODIUM	200.7			0	37900 UG/L		
	1055	SULFATE	300.0			0	285 MG/L		
	1064	CONDUCTIVITY @ 25 C UMHOS/CM	9911			0	1248 SU		
	1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
	1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
	1079	BORON, TOTAL	200.7			0	258 UG/L		
	1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
	1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
	1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
Г	1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
Г	1093	PHOSPHORUS, TOTAL	365.1			0	0.008 MG/L		
	1095	ZINC	200.8	Y	MRL	100 UG/L			
	1915	HARDNESS, TOTAL (AS CACO3)	200.7			0	677000 UG/L		
	1926	PH FIELD	9911			0	6.62 SU		
	1927	ALKALINITY, TOTAL	2320B			0	360 MG/L		
	1930	TDS	2540C			0	1050 MG/L		
	1996	TEMPERATURE (CENTIGRADE)	9911			0	12.59 SU		
	2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
	2010	BHC-GAMMA	525.2	Y	MRL	0.02 UG/L			

2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		1	
	TOXAPHENE	525.2	Y	MRL	1 UG/L			
	ACETOCHLOR	525.2	Y	MRL	1 UG/L			
	DALAPON	515.4	Y	MRL	5 UG/L			
-			Y					
-	DI(2-ETHYLHEXYL) ADIPATE	525.2		MRL	0.6 UG/L			
	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
-	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
	PICLORAM	515.4	Y	MRL	1 UG/L			
	DINOSEB	515.4	Y	MRL	1 UG/L			
	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
-	METOLACHLOR	525.2	Y	MRL	0.25 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L			
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2055	TRIFLURALIN	525.2	Y	MRL	0.05 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
-	DCPA	525.2	Y	MRL	0.5 UG/L		1	
	2,4-D	515.4	Y	MRL	1 UG/L			
	DCPA MONO/DI-ACID							
2108	DEGRADATES	515.4	Y	MRL	0.5 UG/L			
2110	2,4,5-TP	515.4	Y	MRL	1 UG/L			
2251	METHYL TERT-BUTYL ETHER	524.3	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L			
	PENTACHLOROPHENOL	515.4	Y	MRL	0.4 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2378	1,2,4-TRICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2380	CIS-1,2-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
	DICAMBA	515.4	Y	MRL	0.25 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
	PHENOLS	420.4	-	WITCE	0	11.3 UG/L		
2955	XYLENES, TOTAL	524.3	Y	MRL	0.5 UG/L	11.5 CG/E		
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			
2964	DICHLOROMETHANE	524.3	Y	MRL	0.2 UG/L 0.5 UG/L			
2968	O-DICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
-				1				
<u> </u>	P-DICHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.3	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2979	TRANS-1,2-DICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.3	Y	MRL	0.5 UG/L		<b> </b>	
2981	1,1,1-TRICHLOROETHANE	524.3	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.3	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.3	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.3	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.3	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.3	Y	MRL	0.5 UG/L			
2990	BENZENE	524.3	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.3	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.3	Y	MRL	0.5 UG/L			
2996	STYRENE	524.3	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING	9911			0	20 SU		
0002	(MIN)				U			
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	230 SU		
9998	OXIDATION-REDUCTION	9911			0	2 SU		
	POTENTIAL (EH)				-			

## **Drinking Water Branch**

## **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type :

Water System Name : PRAIRIE PATH WATER COMPANYCLARENDON State Type : C

Principal County Served : DU PAGE Primary Source : GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 0111379-01
 Collection Date :
 11-05-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

County Map

**Glossary** 

Analyte		Method	Less	Level	Reporting	Concentration	Monitoring	
Code	<b>Analyte Name</b>	Code	than	Type	Level	level	Period	Period End
Couc		Couc	Indicator	Турс	LCVCI	icvei	<b>Begin Date</b>	Date
1028	IRON	200.7			0	1.1 MG/L	10-01-2020	12-31-2020
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022

## **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type : C

Water System Name : PRAIRIE PATH WATER COMPANYCLARENDON State Type : C

Principal County Served: DU PAGE Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 18J0801-01\_02
 Collection Date :
 10-23-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

<u>County</u> <u>Map</u>

	I	I	¥	I	ı		3. AT	- · ·
Analyte	A N A TOT	Method	Less	Level	Reporting	Concentration	Monitoring	
Code	Analyte Name	Code	than	Туре		level	reriou	Period End
1002	ALLD MUD (	200.0	Indicator				Begin Date	Date
1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
1003	NITROGEN-AMMONIA AS (N)	350.1	N		0	0.787 MG/L		
1005	ARSENIC	200.8	N		0	1.510 UG/L		
1010	BARIUM	200.8	N		0	24.900 UG/L		
1015	CADMIUM	200.8	Y	MRL	3 UG/L			
1017	CHLORIDE	300.0	N		0	70.000 MG/L		
1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
1024	CYANIDE	335.4	Y	MRL	0.005 MG/L			
1025	FLUORIDE	300.0	N		0	0.252 MG/L		
1028	IRON	200.7	N		0	801.000 UG/L		
1030	LEAD	200.8	Y	MRL	5 UG/L			
1031	MAGNESIUM	200.7	N		0	54300.000 UG/L		
1032	MANGANESE	200.8	N		0	31.000 UG/L		
1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
1036	NICKEL	200.8	Y	MRL	25 UG/L			
1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
1042	POTASSIUM	200.7	N		0	4690.000 UG/L		
1045	SELENIUM	200.8	Y	MRL	2 UG/L			
1049	SILICA	200.7	N		0	14100.000 UG/L		
1050	SILVER	200.8	Y	MRL	10 UG/L			
1051	STRONTIUM	200.7	N		0	1760.000 UG/L		
1052	SODIUM	200.7	N		0	34800.000 UG/L		
1055	SULFATE	300.0	N		0	316.000 MG/L		
1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
1079	BORON, TOTAL	200.7	N		0	276.000 UG/L		
1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
1095	ZINC	200.8	Y	MRL	100 UG/L			
1915	HARDNESS, TOTAL (AS CACO3)	200.7	N			659000.000 UG/L		
1919	CALCIUM	200.7	N		0	174000.000 UG/L		
1930	TDS	2540C	N		0	948.000 MG/L		
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			

2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L
2990	BENZENE	524.2	Y	MRL	0.5 UG/L
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L
2996	STYRENE	524.2	Y	MRL	0.5 UG/L

## **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type : C

Water System Name : PRAIRIE PATH WATER COMPANY-CLARENDON State Type : C

Principal County Served: DU PAGE Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 7101174-01
 Collection Date :
 10-05-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

<u>County</u> <u>Map</u>

Glossary

	1		_	ı	ı	I		
Analyte		Method	Less	Level	Reporting	Concentration	Monitoring	
Code	Analyte Name	Code	than	Type		level	Period	Period End
			Indicator	-JP-			<b>Begin Date</b>	
1028	IRON	200.7			0	1 MG/L	10-01-2017	12-31-2017
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019

## **Chem/Rad Sample Results**

Return Links

Water System No.: IL0435300 Federal Type: C

Water System Name : PRAIRIE PATH WATER COMPANYCLARENDON State Type : C

Principal County Served : DU PAGE Primary Source : GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 16F1188-01\_03
 Collection Date :
 06-27-2016

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water
System
Detail

Water Systems

Water System Search

<u>County</u> <u>Map</u>

Glossary

	1			ı	T	T		
Analyte	Analyta Nama	Method	Less	Level	Reporting	Concentration	Monitoring Period	Monitoring Period End
Code	Analyte Name	Code	than Indicator	Type	Level	level	Begin Date	Date
1 2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L		2082	2000
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2910	PHENOLS	420.4	Y	MRL	10 UG/L			
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2990	BENZENE	524.2	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L			
2996	STYRENE	524.2	Y	MRL	0.5 UG/L			

## **Drinking Water Branch**

## **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type :

Water System Name:

PRAIRIE PATH WATER COMPANYState Type:

CLAPENDON

CLAPE

Principal County Served: DU PAGE Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 4100806-01
 Collection Date :
 10-01-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte List

Samples

Chem/Rad

Water System Detail

Water Systems

Water System Search

<u>County</u> <u>Map</u>

Glossary

1 2251 1	Analyte Name	Method	Less	_			Manitarina	N/ i4
Code	Analyte Name		4.78	Level	Reporting	Concentration		Monitoring
1 2251 1		Code	than	Type	Level	level	Period	Period End
1 2251 1	CETALLY TERM DATE.		Indicator	V I			Begin Date	Date
E	METHYL TERT-BUTYL THER	524.2	Y	MRL	0.5 UG/L			
1 737X 1	,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
1 2380 1	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2955 X	YYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2964 D	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968 O	D-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969 P	-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976 V	'INYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2977 1,	,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
/ 1 / 1/4 / 4	RANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980 1,	,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981 1,	,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
1 2982 1	CARBON ETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983 1,	,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984 T	RICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985 1,	,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987 T	ETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989 C	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990 B	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991 T	OLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992 E	THYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996 S'	TYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

#### **Chem/Rad Sample Results**

Return Links

Water System No. : IL0435300 Federal Type:

PRAIRIE PATH WATER COMPANY-Water System Name:

State Type: C

**Principal County Served:** Chem/Rad

CLARENDON **DU PAGE** 

GW **Primary Source:** 01-01-1965

Status: Lab Sample No. : Α SG40361-01 02 **Activity Date:** 07-07-2014 **Collection Date:** 

C

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

**Analyte** List

Samples

Water System Detail

Water Systems

Water System Search

County Map

		Analyte Name	Method Code	than			Concentration	Period	Period End
1	1025		Couc		1 3710 O			1	i ciioa Liia
				Indicator	Type	Level	level	<b>Begin Date</b>	Date
-	2005	FLUORIDE	4500F-C	N		0	0.271 MG/L		
		ENDRIN	525.2	Y	MRL	0.1 UG/L			
	2010	BHC-GAMMA	525.2	Y	MRL	0.02 UG/L			
2	2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
	2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
	2027	ACETOCHLOR	525.2	Y	MRL	1 UG/L			
	2031	DALAPON	515.1	Y	MRL	5 UG/L			
	2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
	2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
7 2	2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
	2040	PICLORAM	515.1	Y	MRL	1 UG/L			
	2041	DINOSEB	515.1	Y	MRL	1 UG/L			
<u> </u>	2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
	2045	METOLACHLOR	525.2	Y	MRL	0.25 UG/L			
	2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L			
	2051	LASSO	525.2	Y	MRL	0.2 UG/L			
	2054	CYANAZINE	525.2	N		0	0.00 UG/L		
	2055	TRIFLURALIN	525.2	Y	MRL	0.05 UG/L			
	2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
1	2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
1	2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
	2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
	2098	BROMACIL	525.2	Y	MRL	1 UG/L			
	2105	2,4-D	515.1	Y	MRL	1 UG/L			
	2110	2,4,5-TP	515.1	Y	MRL	1 UG/L			
	2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
		HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
1	2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L			
1	2326	PENTACHLOROPHENOL	515.1	Y	MRL	0.4 UG/L			
	2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
		1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
		CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
	2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.4 UG/L			
	2440	DICAMBA	515.1	Y	MRL	0.25 UG/L			
	2595	METRIBUZIN	525.2	Y	MRL	0.1 UG/L			
	2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
	2910	PHENOLS	420.4	Y	MRL	10 UG/L			
	2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
	2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			
	2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
	2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
	2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			

2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		
9915	ACIFLUORFEN	515.1	Y	MRL	0.5 UG/L		

**Total Number of Records Fetched = 58** 

## **Chem/Rad Sample Results**

**Return Links** 

<u>Chem/Rad</u> <u>Samples</u>

**Analyte List** 

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name: PRAIRIE PATH WATER COMPANY-CLARENDON State Type: C

Principal County
Served:

DU PAGE
Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 8012699-01
 Collection Date :
 01-17-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Water Systems

Water System
Search

County Map

**Glossary** 

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	1 0	Concentration	Monitoring Period Begin Date	Period End
4010	COMBINED RADIUM (-226 & -228)	null	null		null null	1.07 PCI/L	01-01-2017	12-31-2022
4020	RADIUM- 226	903.1	Y	MRL	0.692 PCI/L			
4030	RADIUM- 228	904.0			0	1.07 PCI/L		

## **Chem/Rad Sample Results**

**Return Links** 

<u>Chem/Rad</u> <u>Samples</u>

Analyte List

Water System
Detail

Water System No.: IL0435300 Federal Type: C

Water System Name: PRAIRIE PATH WATER COMPANY-CLARENDON State Type: C

Principal County
Served:

DU PAGE
Primary Source: GW

 Status :
 A
 Activity Date :
 01-01-1965

 Lab Sample No. :
 3085603001
 Collection Date :
 01-02-2013

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Water Systems

Water System
Search

County Map

**Glossary** 

Analyte Code	Analyte Name	Method Code	Less than Indicator	Tyno		Concentration level	0	Monitoring Period End Date
	COMBINED RADIUM (-226 & -228)	null	null	MRL	null null	0.849 PCI/L	01-01-2011	12-31-2013
4020	RADIUM- 226	903.1	N	MRL	0.46 PCI/L	0.849 PCI/L	01-01-2011	12-31-2013
4030	RADIUM- 228	904.0	Y	MRL	0.753 PCI/L		01-01-2011	12-31-2013
4109	GROSS ALPHA PARTICLE ACTIVITY	900	N	MRL	0.484 PCI/L	2.06 PCI/L	01-01-2011	12-31-2013