



Oakwood
Source Water Protection
Plan

Vermillion County, IL
June 2024

ENGINEERING ENTERPRISES, INC.



SOURCE WATER PROTECTION PLAN

Prairie Path Water Company – Oakwood

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE NO.</u>
1.0 INTRODUCTION.....	1-1
1.1 Background	1-1
2.0 VISION STATEMENT	2-1
2.1 Policy and Commitment to Protecting Source Water	2-1
2.2 Reasons to Protect Source Water	2-1
2.3 Barriers to Protecting Source Water	2-2
2.4 Names of the Individuals Who Developed the Vision Statement	2-3
3.0 SOURCE WATER ASSESSMENT	3-1
3.1 Statement of the Importance of Source Water	3-1
3.2 List of Water Supplies that Obtain Water from the Community Water Supply ...	3-1
3.3 Delineation of all Sources of Water Used by the Community Water Supply	3-2
3.4 Report on the Quality of the Source Water for All Sources of Water.....	3-7
3.5 Report on the Quality of the Finished Water	3-8
3.6 Identification of Potential Sources of Contamination to the Source Water	3-11
3.7 Analysis of the Source Water's Susceptibility to Contamination	3-13
3.8 Explanation of the Community Water Supply's Efforts to Protect Its Source Water	3-13
4.0 SOURCE WATER PROTECTION PLAN OBJECTIVES.....	4-1
4.1 Identified Concerns	4-1
4.2 Objectives.....	4-1
5.0 ACTION PLAN	5-1
5.1 Projects, Programs, and Activities to Meet Objectives	5-1
5.2 Schedule for Implementing Projects, Programs, and Activities	5-1
5.3 Identification of Necessary Resources to Implement the Plan	5-1
5.4 Identification of Potential Problems and Obstacles in Implementing the Plan....	5-2

Tables

3-1	Oakwood CWS Intake Protection Zones.....	3-4
3-2	Finished Water Quality Summary	3-9
3-3	PFAS Sampling Results (from 2023 Annual Water Quality Report).....	3-10
3-4	List of Potential Contaminant Sites	3-12
5-1	Source Water Protection Plan Schedule	5-3 and 5-4

Exhibits

1-1	Oakwood Municipal Boundary and Water Supply Wells	1-2
3-1	Oakwood CWS and Surrounding Sub-Watersheds	3-2
3-2	Oakwood CWS Service Area, Surface Water Intake, and Reservoir	3-5
3-3	Protection Area Delineation	3-5
3-4	Protection Area Within 1,5000 Feet of Primary Waterway	3-6
3-5	Water Body Report for Salt Fork Vermilion River.....	3-7
3-6	Water Body Report for Oakwood Reservoir	3-7
3-7	Atrazine Concentration Trend	3-8
3-8	Map of Potential Sources of Contamination	3-11

Appendices

Appendix A.....	Source Water Protection Plan Regulations
Appendix B.....	Representative Source Water Quality Analytical Reports

SECTION 1: INTRODUCTION

Prairie Path Water Company (PPWC) owns and operates the Oakwood Community Water System (CWS) (IL1830600) according to the rules and regulations of the State of Illinois. On July 26, 2019, the Illinois Pollution Control Board passed new and updated regulations for community water systems including Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan. The purpose of this new requirement is to facilitate protection of source water quality and quantity throughout the State. It requires each community water supply that treats surface or groundwater as a primary or emergency supply of water to develop a Source Water Protection Plan (SWPP). The SWPP must contain the following minimum elements:

- a) a vision statement;
- b) a source water assessment;
- c) the objectives; and
- d) an action plan.

The specific requirements for each of the elements list above are contained in the regulation, which is included herein as Appendix A. This report is submitted to the Illinois Environmental Protection Agency (IEPA) in fulfillment of the Oakwood CWS's requirement under Subpart C – Source Water Protection Plan.

1.1 Background


The Oakwood CWS is in Vermilion County (Exhibit 1-1). The CWS is comprised of a network of various supply, treatment, storage, distribution, and control components. The water system components are specifically designed and operated to provide safe, reliable, and affordable drinking water to the Oakwood CWS water customers. The existing supply draws water from the Salt Fork of the Vermillion River and is stored in the West Reservoir (IN45102) and the East reservoir (IN45103).

Water from the Salt Fork of the Vermillion River is pumped to either of the two reservoirs located at the water treatment plant. The raw water is then pumped from the reservoirs to the water treatment units for coagulation, sedimentation, and filtration. The filtered water disinfected using sodium hypochlorite and fluoride is added for dental health before it reaches the clear well. The finished water is pumped to the water distribution system using two high-service pumps. The

finished water is distributed to Oakwood’s CWS’s service population of 1600 delivered through 725 residential water service connections.

The effectiveness of the system depends on the availability and quality of the water used as the source of water (source water). Significant changes in source water availability or quality often require costly modifications to the water system. Therefore, the Oakwood CWS benefits from Source Water Protection because the program can reduce the risk of source water impairment.

Exhibit 1-1: Oakwood CWS Location Map

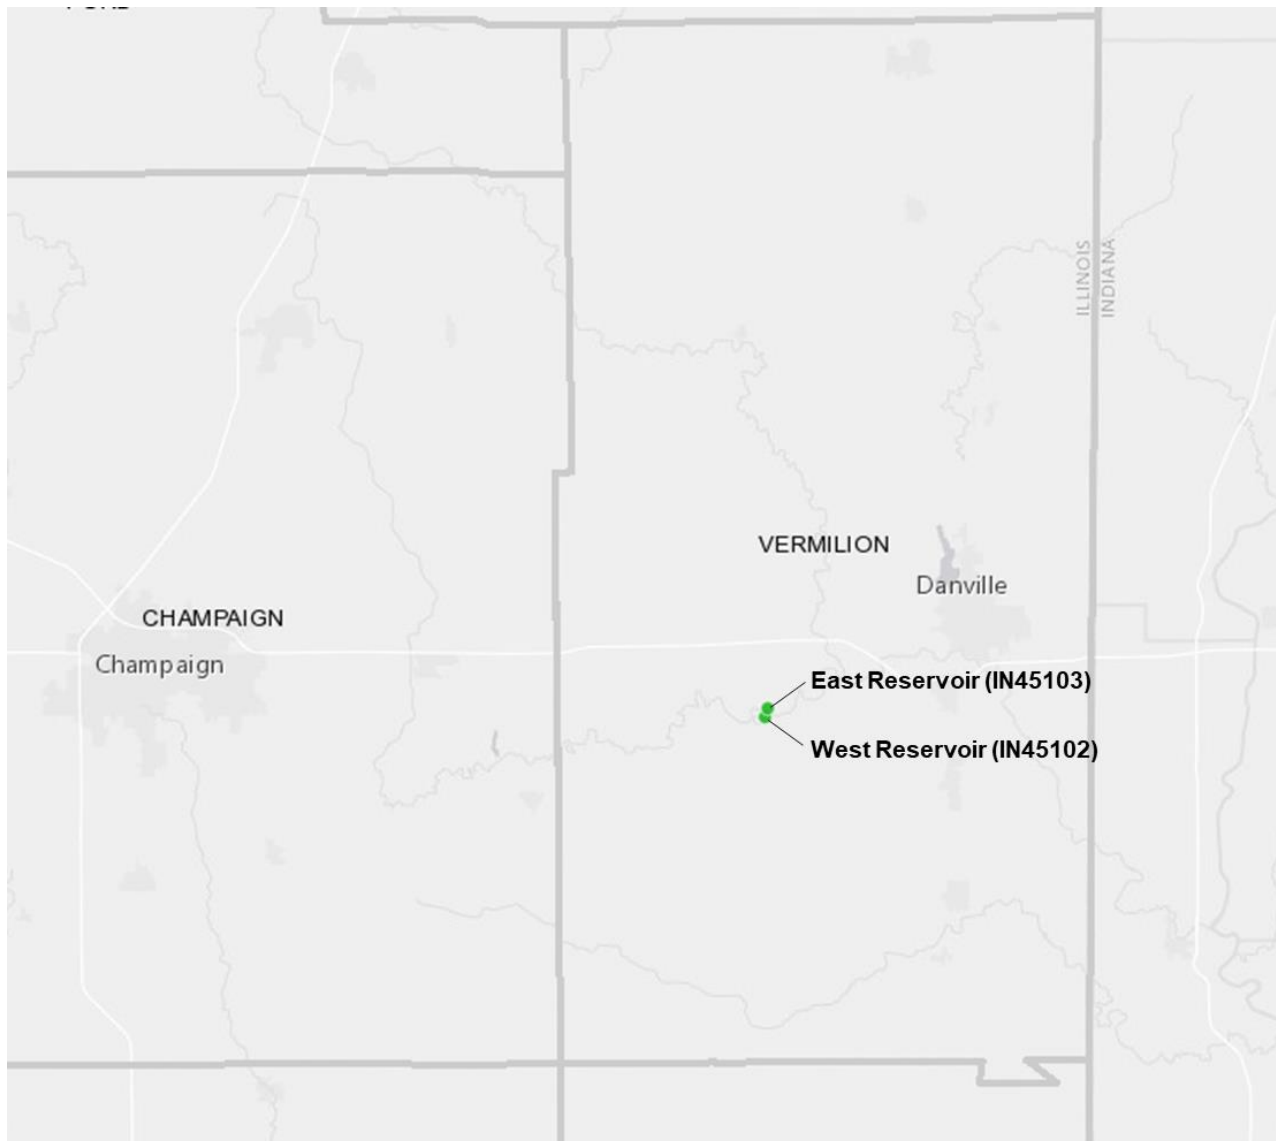

SECTION 2: VISION STATEMENT

This section presents the System's adherence to the requirements of Section 604.310 Vision Statement, which are:

The vision statement must include the following:

- a) the community water supply's policy and commitment to protecting source water;*
- b) an explanation of the community water supply's resources to protect source water;*
- c) an explanation of the barriers to protecting source water; and*
- d) the names of the individuals who developed the vision statement.*

2.1 Policy and Commitment to Protecting Source Water

The Prairie Path Water Company - Oakwood CWS policy and commitment to protect source water begins with the following vision statement:

Prairie Path Water Company is committed to Source Water Protection Programs with the purpose of ensuring the safety, integrity and sustainability of our communities' drinking water, for current and future generations to come, all in an effort to help people enjoy a better life and help communities thrive.

2.2 Resources to Protect Source Water

Prairie Path Water Company commits the following resources to protect the source water of the Oakwood CWS:

- Human capital and financial resources to protect our source water and to back our commitment to the preservation of safe and sustainable drinking water.
- Staff time and effort to regularly monitor the well supply, monitor changes in potential sources of contamination, and regularly coordinate with local zoning officials to identify future potential sources of contamination.
- Engaging consultants to update the existing source water protection plan to demonstrate the System's commitment to continually improving the plan with updated

information and incorporating lessons learned through experience.

- Development and continual updates to the Oakwood CWS Emergency Response Plan.

2.3 Barriers to Protecting Source Water

The key to ensuring clean, safe and reliable drinking water is to understand the drinking water supply from the source all the way to the consumer's tap. This knowledge includes understanding the general characteristics of the water and the land surrounding the water source, as well as mapping all the real and potential threats to the water quality. These threats can be natural, such as seasonal droughts or flooding, or created by human activity, such as agriculture, industrial practices, or recreational activities in the watershed. Threats can also arise in the treatment plant or distribution system thanks to operational breakdowns or aging infrastructure.

The multi-barrier approach takes all these threats into account and makes sure there are "barriers" in place to either eliminate them or minimize their impact. It includes selecting the best available source (e.g., lake, river, aquifer) and protecting it from contamination, using effective water treatment, and preventing water quality deterioration in the distribution system. The approach recognizes that while each individual barrier may not be able to completely remove or prevent contamination, and therefore protect public health, together the barriers work to provide greater assurance that the water will be safe to drink over the long term.

By placing integrated barriers from the source to the consumer at the tap, the Oakwood CWS helps protect the population it serves from the risk of contamination and waterborne disease. The System's multiple barrier approach includes:

- Source Water Protection - delineation of areas that contribute surface water to the surface water intake structures, inventory of existing and future threats also referred to as potential sources of contamination, and management of activities in and around the surface water intakes.
- Treatment Systems – disinfection to eliminate pathogens that are responsible for waterborne diseases.

- Distribution Systems – maintaining adequate pressure within the water distribution system to prohibit inflow of non-potable water, controlling pressure during water main breaks using water system valving, conducting water main repairs quickly, and properly disinfecting water mains before they are placed back into service.
- Monitoring programs - 24-hour a day monitoring of the water system using a customized Supervisory Control and Data Acquisition (SCADA) system, frequently collecting, and analyzing water samples, security fencing, and visual inspections of operating facilities.
- Surface Water Intake security – PPWC intake structures are located within a locked perimeter to protect from vandalism or intentional contamination efforts.
- Operational Response – maintaining an emergency response plan, employing certified operators with proper training and experience to operate the water system, commitment of the organization to continuous improvement, and the assistance of outside experts as needed.

2.4 Names of the Individuals Who Developed the Vision Statement

The names of the individuals who developed the Vision Statement are as follows:

- Justin Kersey, PPWC President
- Mike Miller, PPWC Vice-President of Operations
- David Hankins, PPWC Safety and Compliance Manager
- Charlie Hill, PPWC Area Manager
- Tim Holdeman, Engineering Enterprises, Inc.
- Sydney Shaffer, Engineering Enterprises, Inc.
- Jeniece Neville, Engineering Enterprises, Inc.

SECTION 3: SOURCE WATER ASSESSMENT

This section presents the System's adherence to the requirements of Section 604.315 Source Water Assessment, which are:

- a) *The source water assessment must contain the following information:*
 - 1) *statement of the importance of the source water;*
 - 2) *a list of water supplies that obtain water from this community water supply;*
 - 3) *delineation of all sources of water used by the community water supply, including:*
 - A) *for surface water, description of the watershed, map of the watershed, and intake locations;*
 - B) *for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well;*
 - 4) *a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:*
 - A) *when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and*
 - B) *the certified laboratory's results;*
 - 5) *a report on the quality of the finished water;*
 - 6) *identification of potential sources of contamination to the source water;*
 - 7) *analysis of the source water's susceptibility to contamination; and*
 - 8) *explanation of the community water supply's efforts to protect its source water.*

3.1 Statement of the Importance of Source Water

The importance of source water can be conveyed by the importance water plays in the communities it serves. The Oakwood CWS provides water to several residential sites and uses the Salt Fork of the Vermillion River as the source of this water. The system's water supply provides an average of 157,000 gallons per day to a population of approximately 1600 people. Prairie Path Water Company recognizes that no community can exist without a safe, reliable source of drinking water, and protection of that source water is of the utmost importance.


3.2 List of Water Supplies that Obtain Water from the Community Water Supply

The Oakwood CWS currently does not supply water to any Community Water Supplies.

3.3 Delineation of all Sources of Water Used by the Community Water Supply


The source of water for the Oakwood CWS is the Salt Fork of the Vermillion River, which is located within the Salt Fork Sub-Watershed (12-digit Hydraulic Unit Code 051201090605) of the Vermillion Watershed (8-digit Hydrologic Unit Code 05120109) as shown in Exhibit 3-1.

Exhibit 3-1: Oakwood CWS and Surrounding Sub-Watersheds

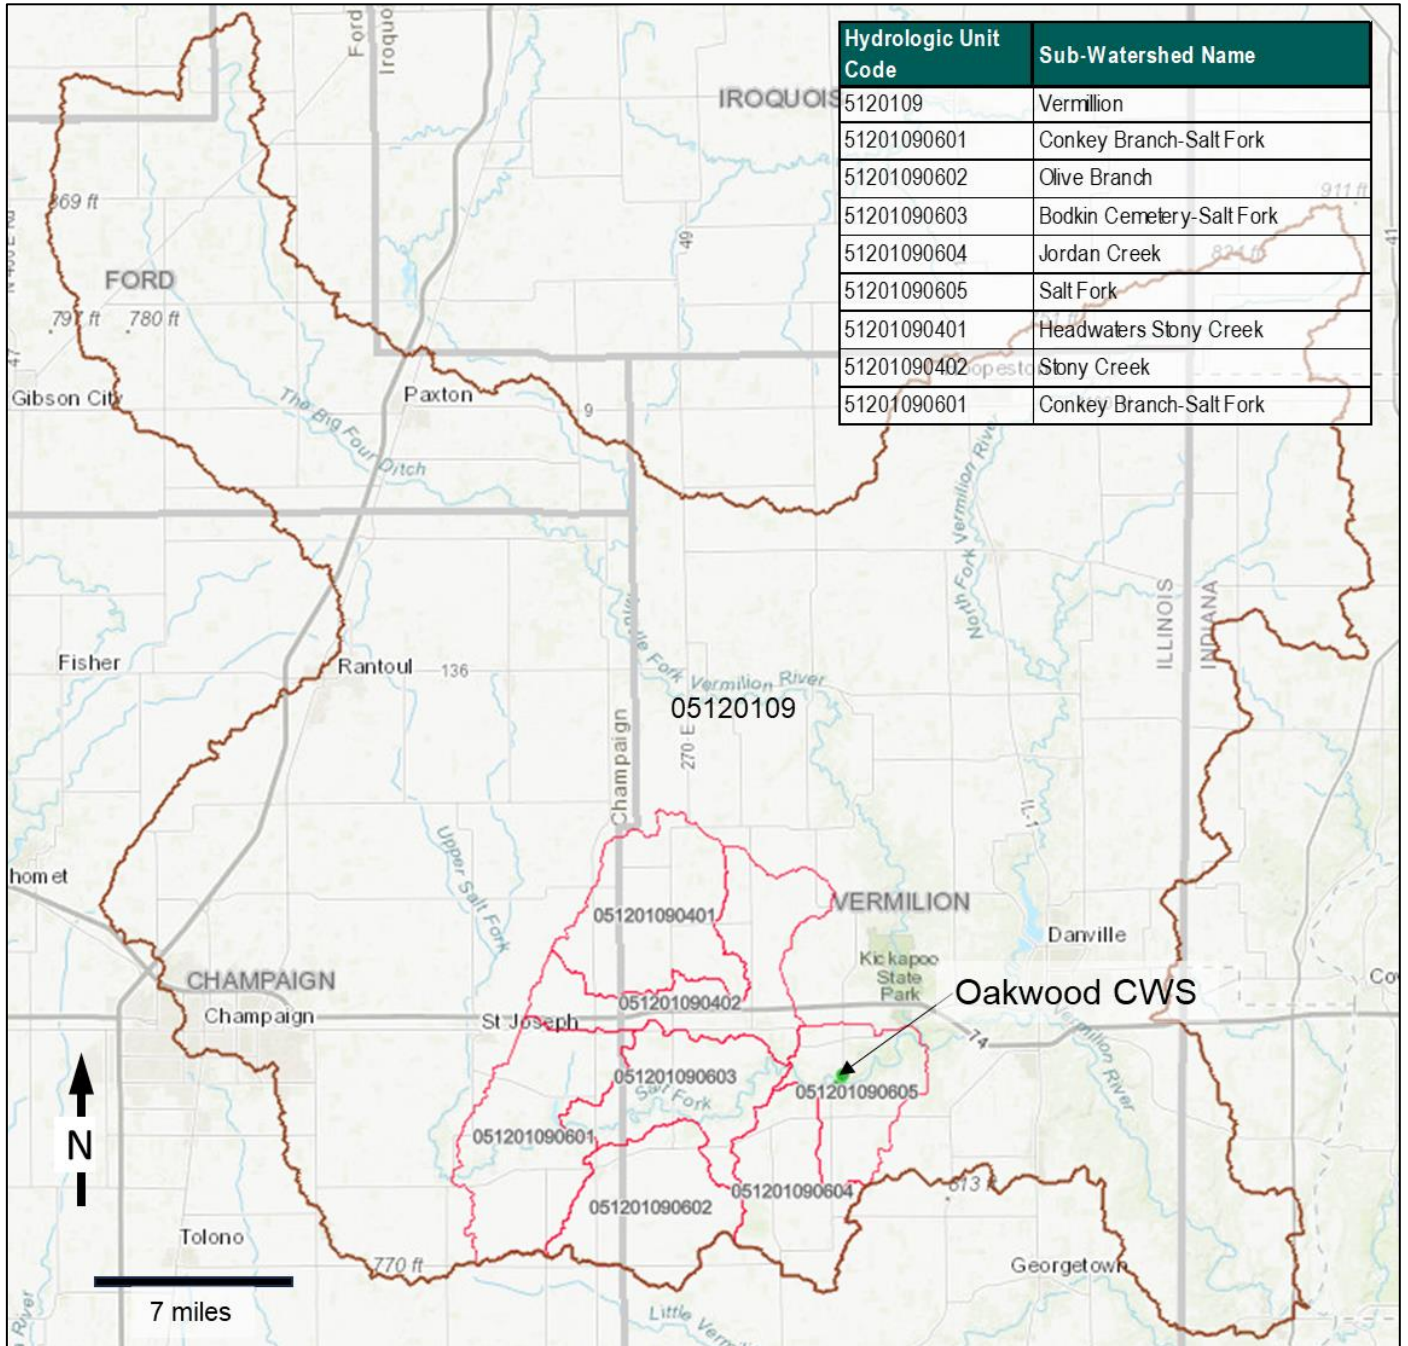

The Oakwood water supply consists of one surface water intake (IN45102) that draws water from the Salt Fork of the Vermilion River and a reservoir (IN45103), which is located approximately 2,000 feet north of the intake structure within the Salt Fork Sub-Watershed (Exhibit 3-2). The Salt Fork Vermilion Sub-Watershed is a smaller, delineated area within the broader Salt Fork Vermilion Watershed in east-central Illinois. It is approximately 22.4 square miles and encompasses a network of streams, creeks, and rivers that ultimately drain into either the Salt Fork River or the Vermilion River, both of which are major tributaries of the Wabash River. The sub-watershed's topography influences the flow of water, with hills, valleys, and other landforms determining how water moves through the landscape and eventually into larger water bodies. Like the broader Salt Fork Vermilion Watershed, land use in the sub-watershed is predominantly agricultural. This includes crops such as corn and soybeans, which can contribute to nutrient runoff and sedimentation in waterways if not managed properly.

Exhibit 3-2: Oakwood CWS Service Area, Surface Water Intake, and Reservoirs

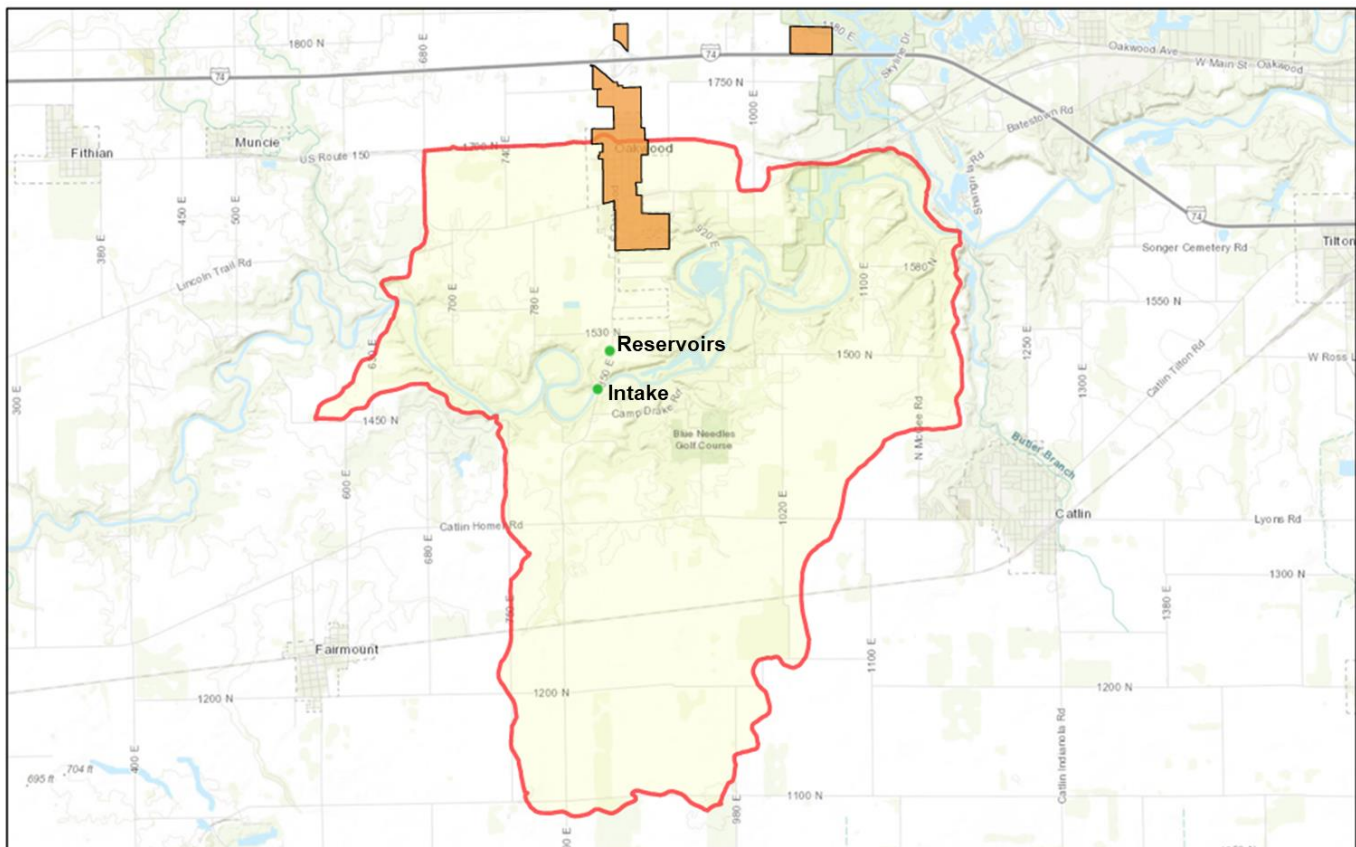


6/26/2024

Oakwood Sanitary Service Area

Prairie Path Water Co Surface Water Inventory 3 30 2023

Salt_Fork_watershed



The sub-watershed supports diverse ecosystems, including riparian zones, wetlands, and woodlands, which provide habitat for wildlife and contribute to overall biodiversity. These natural areas are crucial for maintaining water quality, preventing erosion, and supporting healthy aquatic and terrestrial species. Human activities such as farming, urbanization, and infrastructure development can impact the sub-watershed's health. Challenges include soil erosion, nutrient pollution from fertilizers, habitat fragmentation, and changes in water flow patterns due to land use changes. Efforts to protect and restore the Salt Fork Vermilion Sub-Watershed involve implementing best management practices (BMPs) for agriculture, restoring riparian buffers, conserving wetlands, and managing stormwater runoff in urban areas. These efforts aim to improve water quality, enhance habitat connectivity, and sustainably manage natural resources.

The large size of the Vermillion River watershed warrants a segmentation approach to identify smaller areas for the contaminant source inventory. Three (3) source water protection zones for the Oakwood CWS surface water source were delineated as part of the source water assessment. The surface water protection zones were delineated using a combination of watershed boundaries and flowtimes. The flowtimes were derived using the USEPA Office of Water's Watershed Assessment, Tracking and Environmental Results System (WATERS). The zones delineated are listed in Table 3-1. Maps of the protection zones are presented in Exhibit 3-3.

Table 3-1: Oakwood CWS Intake Protection Zones

Protection Zone Designation	Description
A	Flowtime 0 – 6 hours
B	Flowtime 6 – 12 hours
C	Flowtime 12 -24 hours

In addition, the IEPA CWS River Intake Zone 1 Protection Area, which is an area within 1,500 feet of a primary waterway with a flowtime to the CWS of 24 hours or less was identified and is presented in Exhibit 3-4.

Exhibit 3-3: Protection Area Delineation


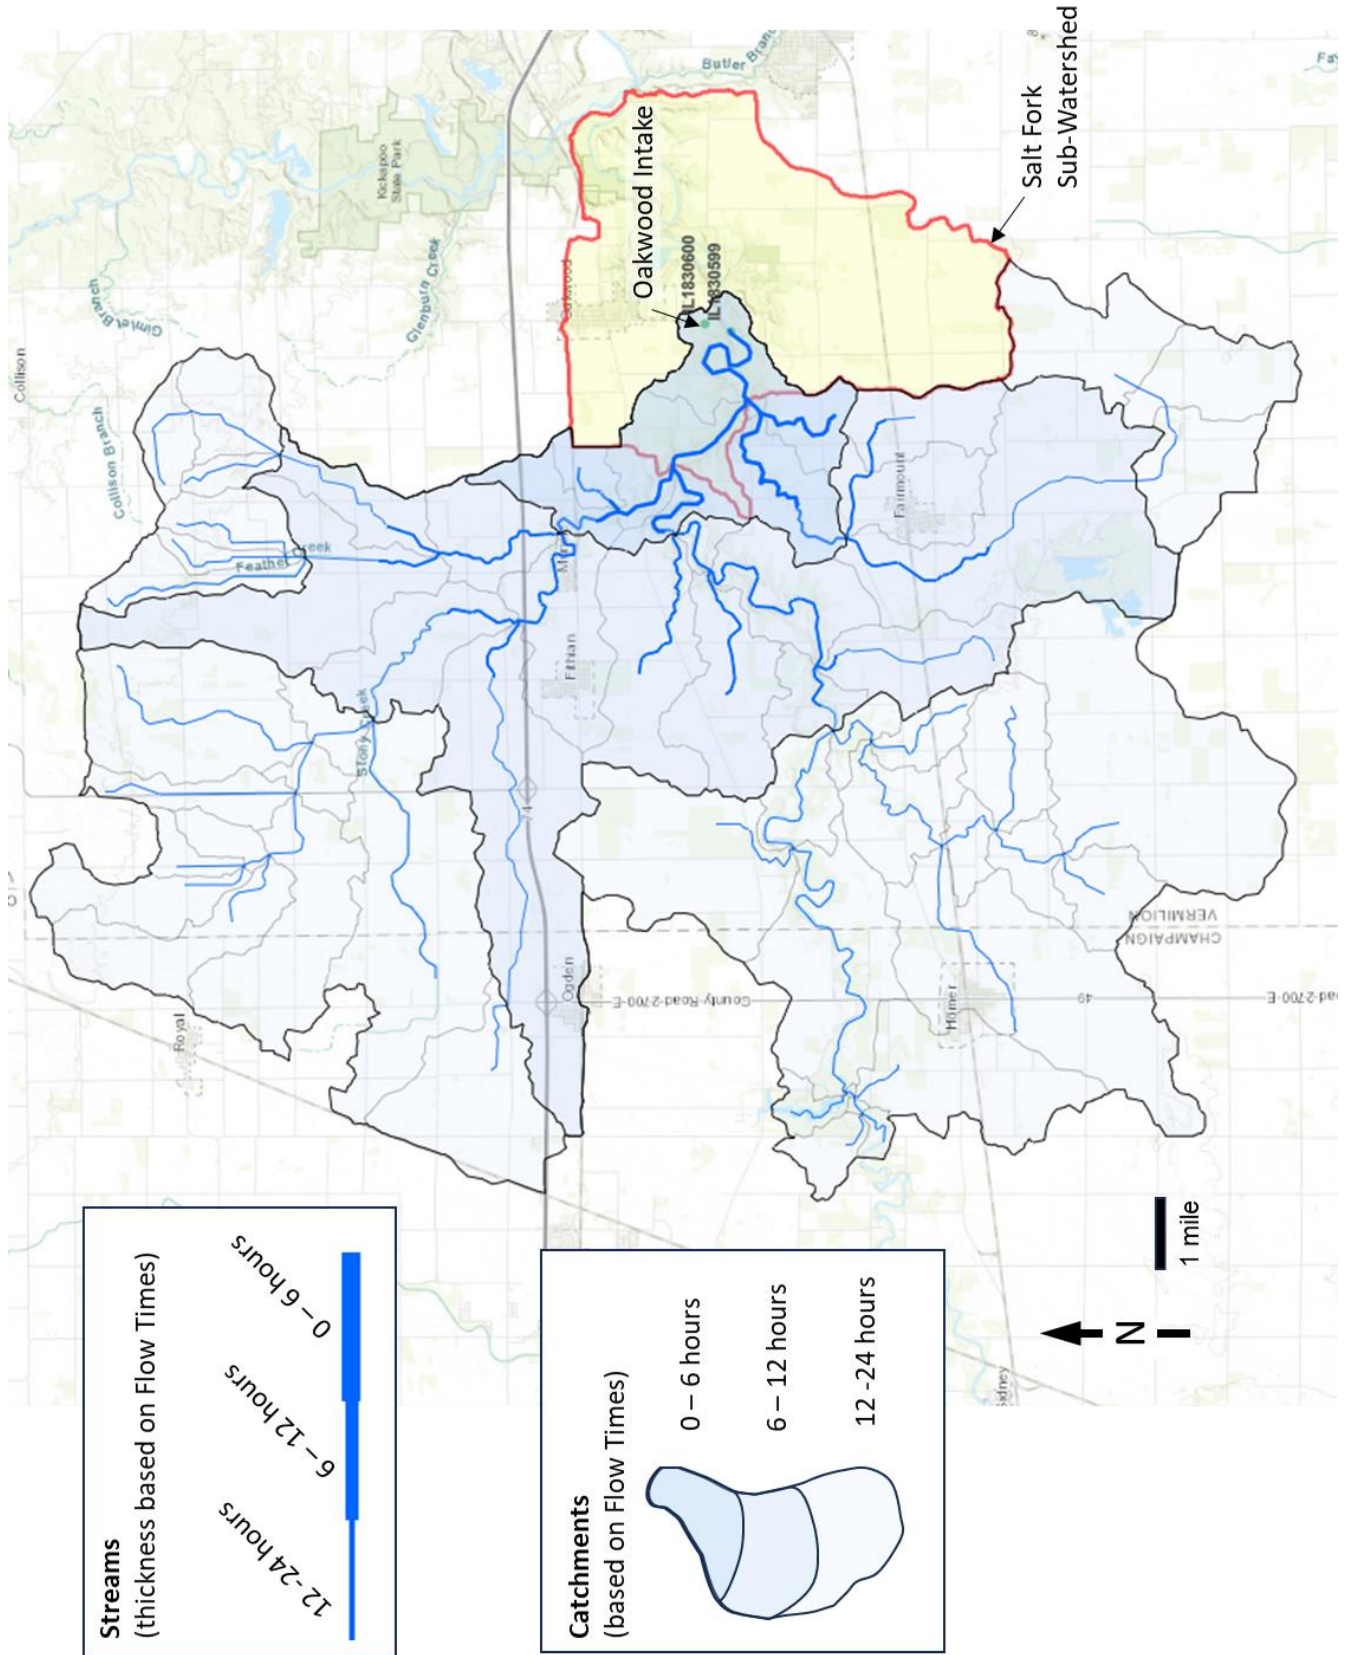


Exhibit 3-4: Protection Area Within 1,500 Feet of Primary Waterway

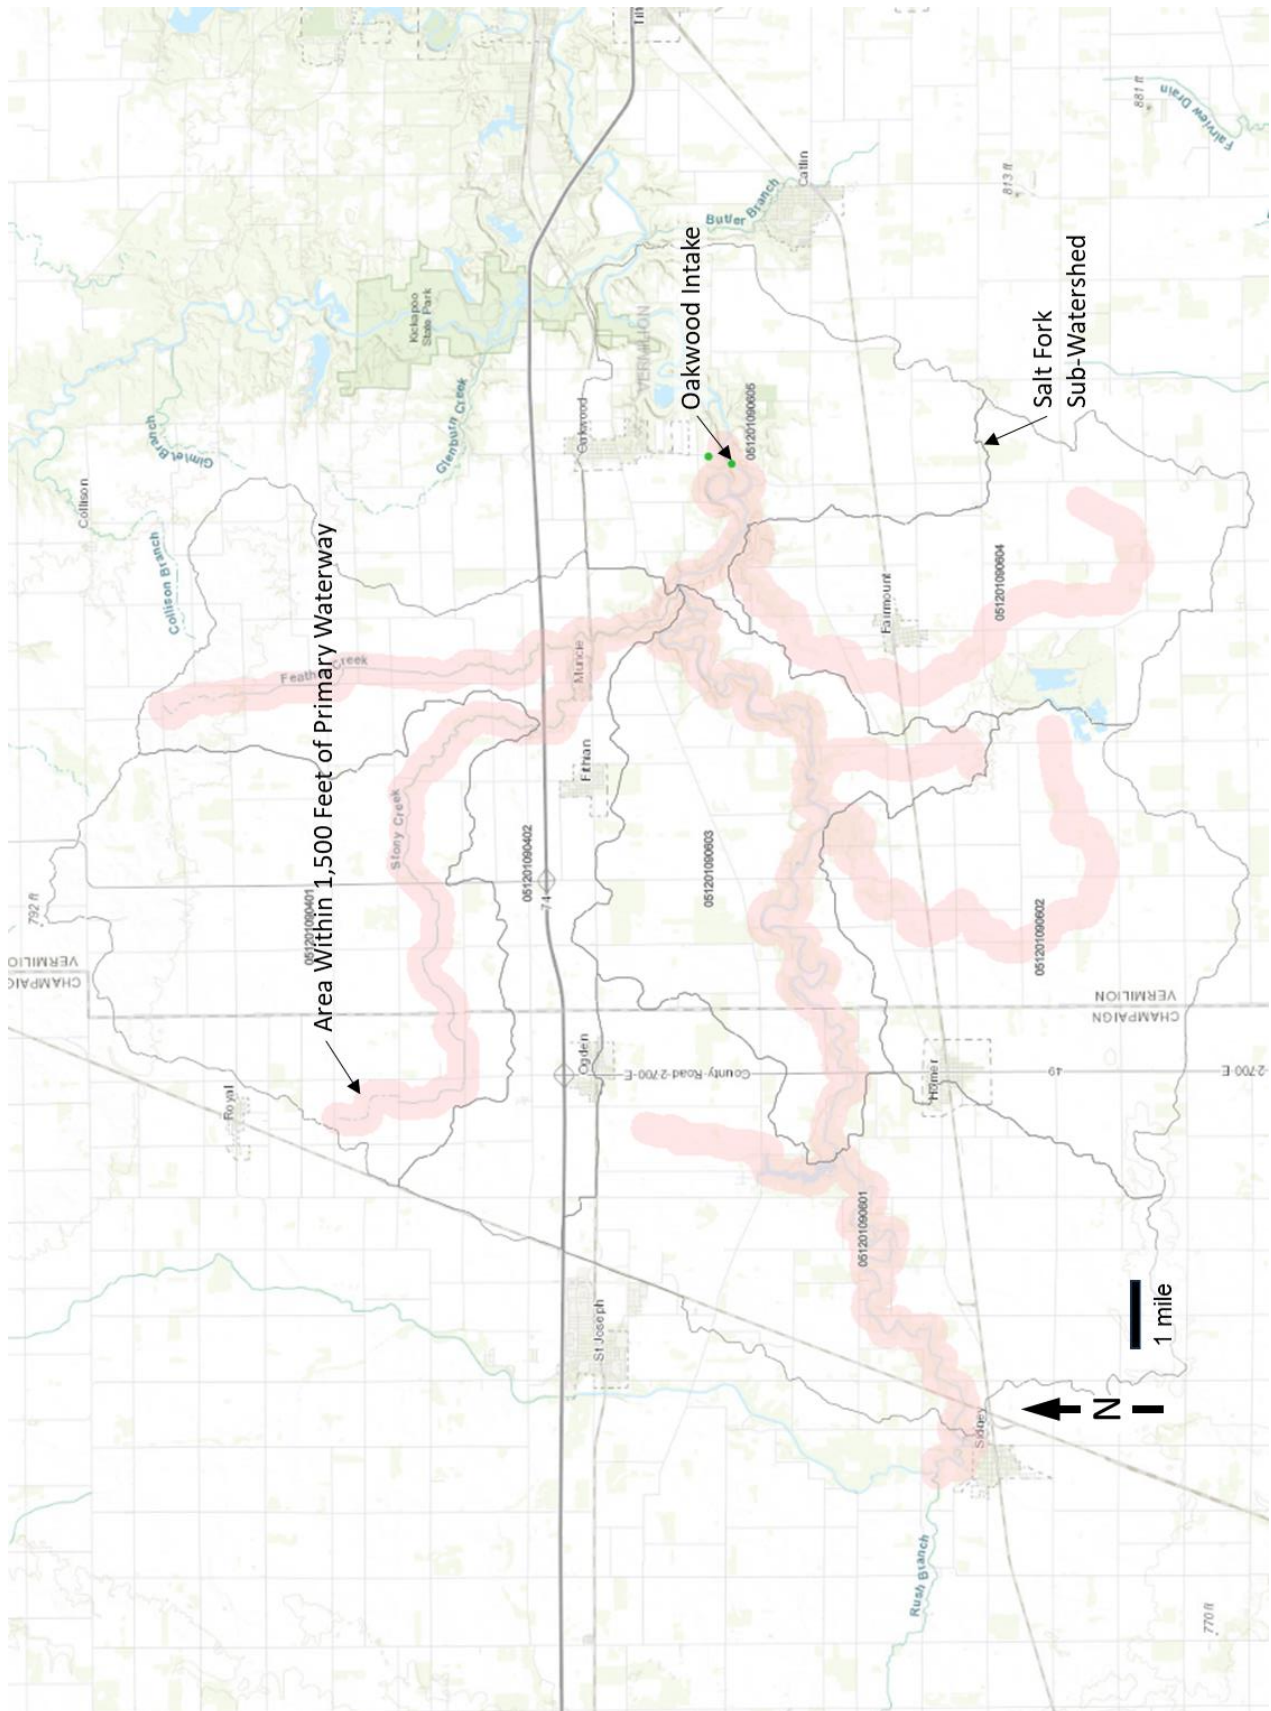

3.4 Report on The Quality of the Source Water for All Sources of Water

Water samples collected from the Oakwood intake are limited. Therefore, the source water quality assessment presented here is based on the IEPA Integrated Water Quality Report 2022. The findings of that report for Salt Fork Vermillion River (Assessment Unit ID: IL_BPJ-03) and the Oakwood CWS Reservoir (State Waterbody ID: ILRBZO) are summarized below.

Exhibit 3-5: Water Body Report for Salt Fork Vermillion River

Salt Fork Vermillion River

State Waterbody ID: IL_BPJ-03

Year Last Reported: 2022

Waterbody Condition: Impaired (Issues Identified)

Organization Name (ID): Illinois (IL_EPA)

What is this water used for?	Condition
Drinking Water	Impaired*
Aquatic Life	Good**
Fish and Shellfish Consumption	Condition Unknown***
Swimming and Boating	Impaired*
Other	Good**

Identified Issues:

- Bacteria and Other Microbes
- Pesticides

*Impaired waters are waterbodies not fully supporting their designated uses under the Clean Water Act.

**Good waters are waterbodies fully supporting their designated uses under the Clean Water Act.

***Condition Unknown is when a waterbody is identified for a specific use but not assessed for that use.

Exhibit 3-6: Water Body Report for Oakwood Reservoir

OAKWOOD RESERVOIR

State Waterbody ID: IL_RBZO

Year Last Reported: 2022

Waterbody Condition: Good

Organization Name (ID): Illinois (IL_EPA)


What is this water used for?	Condition
Drinking Water	Good*
Aquatic Life	Condition Unknown**
Fish and Shellfish Consumption	Condition Unknown**
Swimming and Boating	Condition Unknown**
Other	Condition Unknown**

*Good waters are waterbodies fully supporting their designated uses under the Clean Water Act.

**Condition Unknown is when a waterbody is identified for a specific use but not assessed for that use.

Exhibit 3-5 is a graph of atrazine concentrations from TP01. The graph shows that atrazine concentrations of water sampled at TP01 are not persistent and that concentrations are always less than 1 ug/l. The maximum contaminant level (MCL) for atrazine is 3.0 ug/l.

Exhibit 3-7: Atrazine Concentration Trend

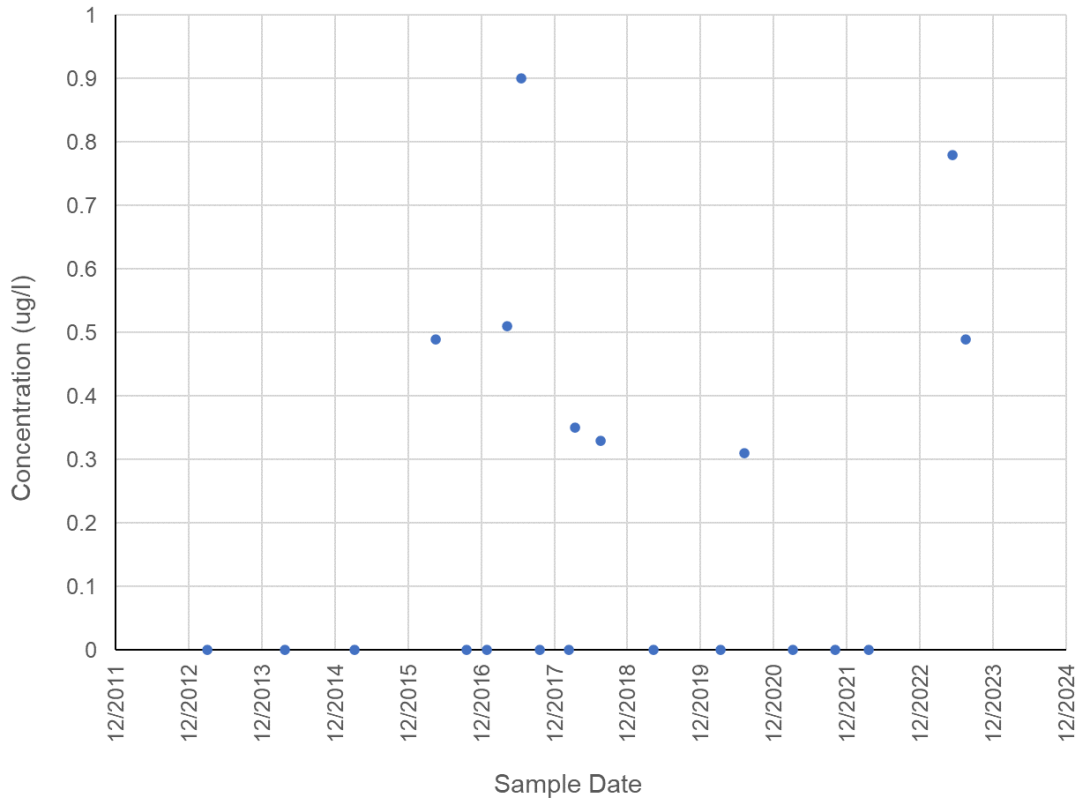

3.5 Report on the Quality of the Finished Water

An analysis of the Oakwood CWS finished water was conducted as part of the Source Water Assessment. Table 3-1 presents a summary of the System's finished water quality based on analytical results from 2013 to 2024 (Appendix B). The System's finished water does not exceed any primary maximum contaminant levels (MCLs).

Table 3-2: Finished Water Quality Summary

			Range	Average	MCL*
Inorganic Compounds	Alkalinity	(µg/L)	130 - 190	161.4	-
	Aluminum	(µg/L)	20 - 43	32.3	50 - 200
	Antimony	(µg/L)	ND	ND	6
	Arsenic	(µg/L)	ND	ND	10
	Barium	(µg/L)	27 - 39	32.8	2000
	Beryllium	(µg/L)	ND	ND	4
	Cadmium	(µg/L)	ND	ND	5
	Calcium	(mg/L)	40 - 60	48.7	-
	Chloride	(mg/L)	32 - 53	32	250
	Chromium	(µg/L)	ND	ND	100
	Cyanide	(mg/L)	ND	ND	0.2
	Fluoride	(mg/L)	0.574 - 1.26	0.80	4
	Iron	(µg/L)	<0.01 - 0.011	<0.01	1
	Magnesium	(µg/L)	26 - 30	27.7	-
	Manganese	(µg/L)	<1 - 10	2.8	50
	Mercury	(µg/L)	ND	ND	-
	Nickel	(µg/L)	ND	ND	-
	Nitrate	(mg/L)	3.6 - 7.3	5.7	10
	Nitrite	(mg/L)	< 0.3	< 0.3	1
	Selenium	(µg/L)	1.1 - 2	1.5	50
	Sodium	(mg/L)	15 - 26	20.5	-
	Sulfate	(mg/L)	21 - 94	39.1	-
	Thallium	(µg/L)	ND	ND	2
	Zinc	(µg/L)	< 6 - 10	< 6.4	-
	Total Dissolved Solids	(mg/L)	250 - 300	274.3	-
Radiochemicals	ALPHA, Gross	pCi/L	0.503	0.503	15
	Radium-226	pCi/L	0.0639	0.0639	-
	Radium-228	pCi/L	0.443	0.443	-
	Combined Radium	pCi/L	0.507	0.507	5
	SOCs ^b	(µg/L)	ND	ND	-
	Atrazine	(µg/L)	ND - 0.9	0.21	3
	VOCs ^c	(µg/L)	ND	ND	-

Notes:

^a Results from Safe Drinking Water Information System (SDWIS) Lab NR = No Record
 Sample Numbers GE02831-01, ED01159-01, 0041825-01, 9052035-01 ND = Non Detect
 8042672-01, 7051467-01, 6053044-01, 5041752-01, 4043646-01, 3040795-01

^b Atrazine is only SOC detected, Detailed laboratory results can be found in Appendix C

^c Detailed laboratory results can be found in Appendix C

Prairie Path Water Company continues efforts to conduct statewide drinking water testing for Per- and Polyfluoroalkyl Substances (PFAS). These man-made compounds are used in the manufacturing of products resistant to water, grease or stains including firefighting foams, cleaners, cosmetics, paints, adhesives and insecticides. PFAS can migrate into the soil, water, and air and is likely present in the blood of humans and animals all over the world. During 2023,

the Environmental Protection Agency (EPA) had Health Advisory Levels (HALs) for GenX, PFBS, PFOA, and PFOS. On April 10, 2024, the EPA approved new drinking water standards for six PFAS including PFOA, PFOS, PFNA, PFHxS, PFBS, and GenX Chemicals. The water quality reports in the form of Consumer Confidence Report can be found on the System's website at: <https://www.myutility.us/prairiepathwater/water-safety/water-quality-reports>.

Table 3-3: PFAS Sampling Results (from 2023 Annual Water Quality Report)

PFAS Results (All results reported as Nanograms per liter (ng/L))					
Contaminant	Sample Date	Range of Detect	Average	EPA MCLG	EPA MCL
PFHpA	01/30/2023	N/A	2.4		
PFBS*	01/30/2023	N/A	ND		
PFHxS*	01/30/2023	N/A	9.2	10	10
PFOA	01/30/2023	N/A	3.1	0	4.0
PFOS	01/30/2023	N/A	11**	0	4.0
PFNA*	01/30/2023	ND	N/A	10	10
HFPO-DA (GenX)*	01/30/2023	ND	N/A	10	10
Hazard Index*	01/30/2023	N/A	N/A	1 (unitless)	1 (unitless)

**PFOS: On April 10, 2024, EPA announced the final National Primary Drinking Water Regulation (NPDWR) for six PFAS. Oakwood came back over the new MCL for PFOS of 4.0 PPT. Prairie Path Water Company will continue its monitoring efforts and measures will be taken to meet the new MCL in accordance with required timelines set by the EPA.

Terms and Abbreviations:

- GenX – Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)
- Hazard Index – PFAS mixtures containing at least two or more of PFHxS, PFNA, HFPO-DA, and PFBS use a Hazard Index MCL to account for the combined and co-occurring levels of these PFAS in drinking water.
- Health Advisory Level (HAL) – To provide Americans, including the most sensitive populations, with a margin of protection from a lifetime of exposure to GenX, PFBS, PFOA and PFOS from drinking water, EPA established health advisory levels.
- ND (No Detect) - No detection means the constituent is not detectable at the minimum reporting limit.
- Ng/L – Nanograms per liter (ng/L) which equals Parts per trillion (ppt) – One part per trillion corresponds to one minute in 2,000,000 years, or a single penny in \$10,000,000,000.
- PFBS – Perfluorobutanesulfonic Acid · PFNA – Perfluorononanoic Acid
- PFOA – Perfluorooctanoic Acid · PFOS – Perfluorooctanesulfonic Acid
- PFHpA – Perfluoroheptanoic Acid · PFHxS – Perfluorohexanesulfonic Acid

3.6 Identification of Potential Sources of Contamination to the Source Water

The USEPA web-based program Enforcement and Compliance History Online (ECHO) was used to develop a list of potential sources of contamination of the surface water source. Only

the sites that occur within the portion of the Vermillion watershed that contributes to the Oakwood CWS river intake within 24 hours were inventoried. Exhibit 3-7 shows the location of those sites. Table 3-4 lists the sites, highlighting those sites within 1,500 feet of a primary waterway.

Exhibit 3-8: Map of Potential Sources of Contamination

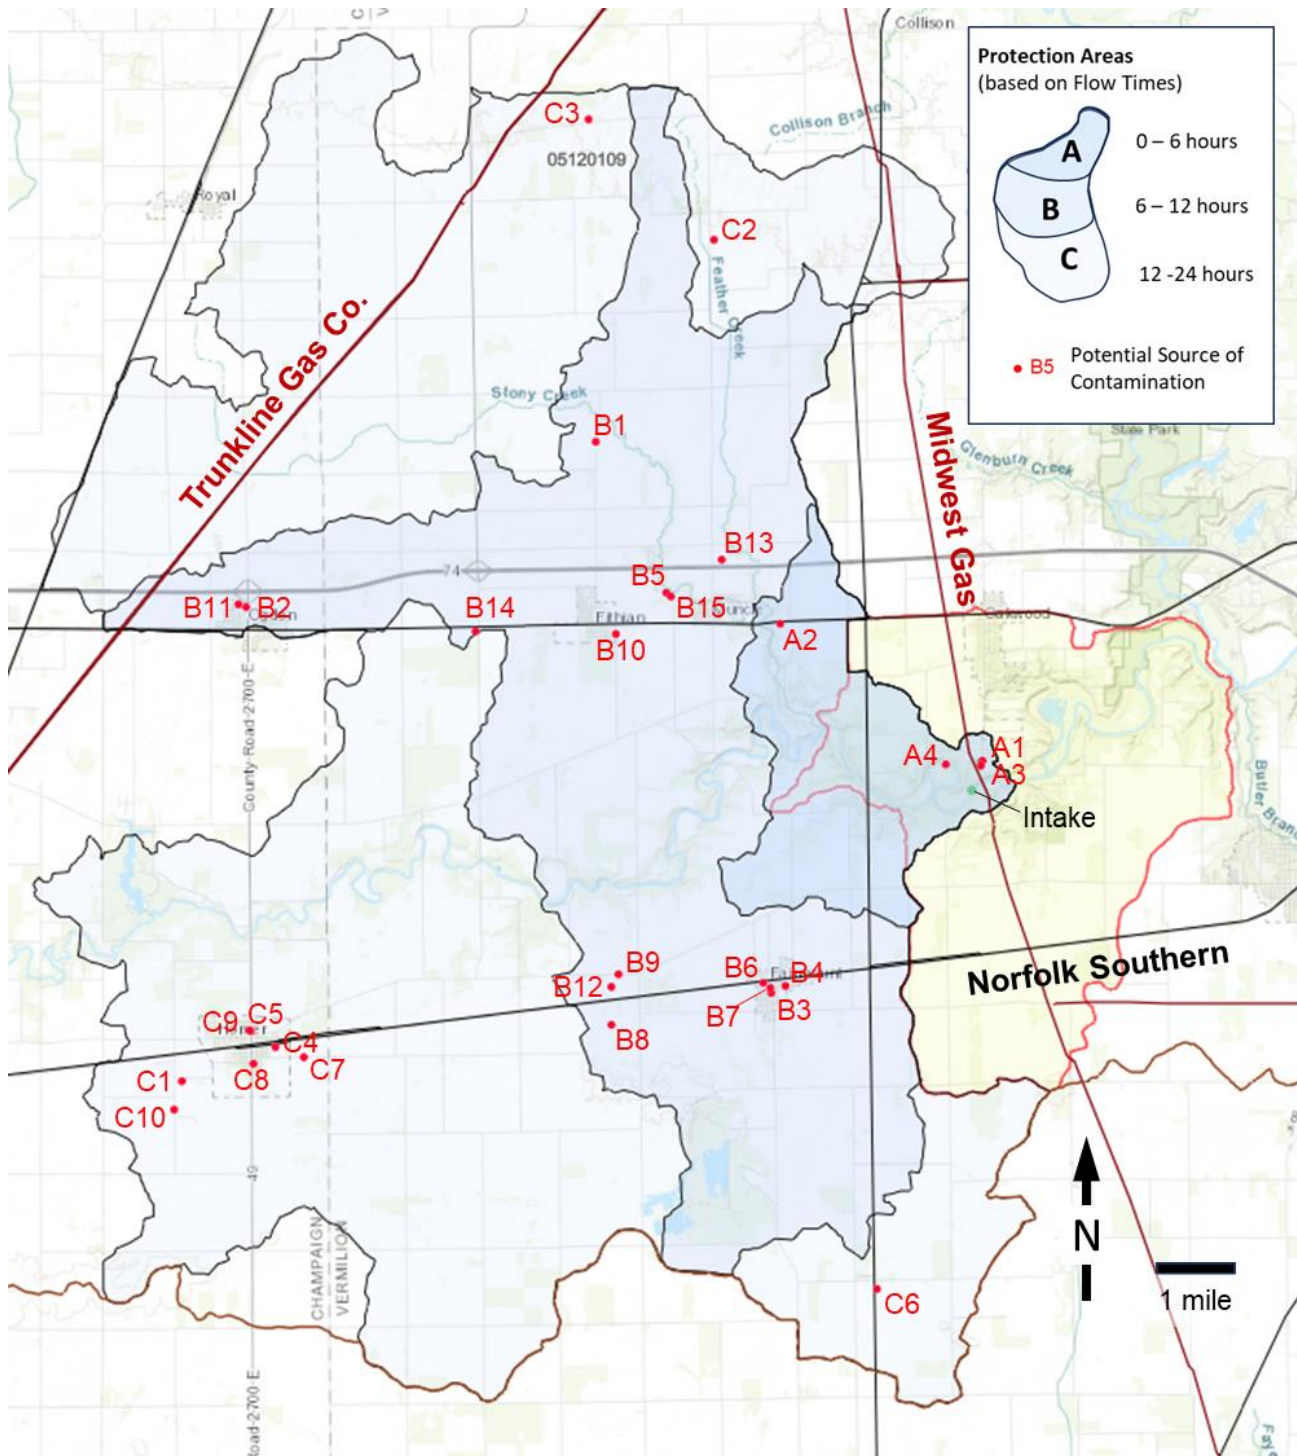


Table 3-4: List of Potential Contaminant Sites

NOTE Highlighted Sites are Within 1,500 Feet of a Primary Waterway

No.	Facility Name	Facility Street	City	Registry ID
A1	GALENA TERRITORY UTILITIES, INC. - OAKWOOD	15124 NORTH 850 EAST ROAD	OAKWOOD	110064582875
A2	OAKWOOD TOWNSHIP HIGH SCHOOL STP	5870 US 150	FITHIAN	110009985123
A3	OAKWOOD WATER TREATMENT PLANT	OAKWOOD	OAKWOOD	110070392532
A4	PRAIRIE PATH WATER COMPANY	E 1530 NORTH RD	OAKWOOD	110070203718
B1	ALEWELT INC	19353 350E RD	FITHIAN	110070102132
B2	COLONIAL PANTRY 7	I-74 & RTE 49 S SW COR	OGDEN	110070361474
B3	FAIRMOUNT WTP	301 S MAIN ST	FAIRMOUNT	110028306544
B4	FAIRMOUNT-TP 01-TREATMENT PLANT	VILLAGE HALL	FAIRMOUNT	110012998346
B5	FITHIAN WTP, VILLAGE OF	450 EAST ROAD	FITHIAN	110043763059
B6	GEORGE FERBER & SONS	WEST CT ST	FAIRMOUNT	110007312684
B7	GEORGE FERBER & SONS/FAIRMOUNT	102 S. PINE	FAIRMOUNT	110010004262
B8	HANSON MATERIAL SERVICE YD 16	PO BOX 50	FAIRMOUNT	110018105833
B9	HEIDELBERG MATERIALS MIDWEST AGG LLC - FAIRMOUNT	3706 CATLIN-HOMER ROAD	THORNTON	110055102240
B10	ILDOT FITHIAN MAINT STOR	RR 1	FITHIAN	110007547191
B11	OGDEN METALWORKS INC	301 N MARILYN AVE	OGDEN	110005939823
B12	OPEN ROAD ASPHALT CO. LLC - FAIRMOUNT	3690 CATLIN-HOMER ROAD	FAIRMOUNT	110001339105
B13	USS VERMILION SOLAR 1 AND 2	4398 EAST 1800 NORTH ROAD	FITHIAN	110071527709
B14	ZAN-NOH GRAIN CORP	16794 NORTH 240 EAST ROAD	FITHIAN	110001818855
B15	ZEN-NOH GRAIN CORPORATION	450 EAST RD	MUNCIE	110063234325
C1	AUGUST BERNING	1097 COUNTY ROAD	HOMER	110035833710
C2	BRADLEY SPORTS COMPLEX	1750 E 5000N ROAD	BRADLEY	110071671495
C3	CALIFORNIA RIDGE WIND ENERGY	3429 E CR 2350N	FITHIAN	110055068395
C4	CONSOLIDATED GRAIN & BARGE CO	402 E COFFEEN ST	HOMER	110001808152
C5	DONS AUTO CENTER INC	202 N MAIN	HOMER	110070161777
C6	FARMER S ELEVATOR CO OF JAMAICA	7061 E 850 N ROAD	FAIRMOUNT	110001811013
C7	HOMER WWTP	2775 COUNTY ROAD 1050 N.	HOMER	110040082549
C8	J&K BODY & PAINT	501 1/2 S MAIN ST	HOMER	110070161776
C9	JOE'S BODY SHOP AND TOWING	205 N. MAIN STREET	HOMER	110039521933
C10	THOMAS J OVERBYE	1178 CR 2500E	HOMER	110054116247

3.7 Analysis of the Source Water's Susceptibility to Contamination

According to the 2001 Source Water Assessment Fact Sheet the IEPA Illinois EPA considers all surface water sources of community water supply to be susceptible to potential pollution problems, hence, the reason for mandatory treatment for all surface water supplies in Illinois. The factsheet can be found here: <https://dataservices.epa.illinois.gov/swap/factsheet.aspx>

Mandatory treatment includes coagulation, sedimentation, filtration, and disinfection. In addition, agricultural runoff within the Vermilion River Basin contributes to the susceptibility of the Oakwood intakes.

3.8 Explanation of the Community Water Supply's Efforts to Protect its Source Water

- The IEPA designates protection zones within 1,500 feet of a primary waterway with a flowtime to the CWS of 24 hours or less.
- The System's SCADA system monitors each well 24/7.
- The Oakwood CWS maintains the Emergency Response Plan as contingency planning documents to ensure that, through emergency preparedness, the community minimizes its risk of being without safe and adequate drinking water.
- The Oakwood CWS is a member of ILWARN, which is a utility-to-utility network that helps water and wastewater utilities recover from disasters by getting resources – personnel and equipment – when and where they are needed.
- Watershed Implementation Plan for the Upper Salt Fork of the Vermilion River Champaign and Vermilion Counties, Illinois, Prepared by the Salt Fork Steering Committee of the Champaign County Soil and Water Conservation District, 2007.
- The following is taken from the Source Water Protection Efforts listed in the IEPA's Source Water Assessment Program Factsheets:

Under Section 319 of the Federal Clean Water Act, U.S. EPA provides grants for the Illinois EPA to finance projects that demonstrate cost-effective solutions to nonpoint source pollution problems and promote public knowledge and awareness of nonpoint source pollution. Statewide projects, which may improve water quality in the Vermilion Watershed, have included:

- Stream Corridor Initiative - Environmentally sound, biotechnical practices were implemented to arrest streambank erosion on a section of the Middle Fork of the Vermilion River (ILBPK07).*
- North Fork Vermilion River Project - Operators in the North Fork Vermilion River (ILBPG09) watershed were contacted to increase awareness and to help them adopt conservation measures. Best management practices (BMPs) were designed and constructed to reduce siltation and nutrient/pesticide transport. BMPs to be used in this project included 6,150 feet of terraces and 7.5 acres of waterways. Public meetings will be conducted to increase awareness to all citizens in the watershed.*
- North Fork Vermilion River Project Phase 2 - Operators in the area will be contacted to increase awareness and to help them adopt conservation measures. Best management practices (BMPs) will be designed and constructed to reduce siltation and nutrient/pesticide transport. BMPs to be used in this project include conservation tillage, buffer strips, grade stabilization structures, wildlife plantings, and terraces. Public meetings will be conducted to increase awareness to all citizens in the watershed. This is a continuation of an effort on the North Fork Vermilion River initiated with FFY97 Section 319 funding. The North Fork Vermilion River is a Category 1 watershed in the Unified Watershed Assessment.*
- Little Vermilion River WRAS Development - The Illinois EPA will assist local stakeholders with the development of a Watershed Restoration Action Strategy (WRAS) for the Little Vermilion River watershed, which is a Category 1 watershed identified in the Unified Watershed Assessment. The WRAS shall be consistent with the Illinois EPA's draft Guidance for Developing Watershed Implementation Plans. The WRAS shall identify all of the resources, identify the sources and causes of pollution, and specify the recommended best management practices for restoration and protection of the watershed. In an effort to minimize the impact of livestock facilities on water resources on a statewide basis, livestock facilities are now regulated under the Livestock Management Facilities Act. This legislation is designed to keep Illinois' livestock industry productive and environmentally responsible by establishing requirements for design, construction, operation and management of livestock facilities and waste-handling structures. Detailed information on the Livestock Management Facilities Act may be found at the website <http://www.agr.state.il.us>. In addition, the watershed protection efforts and priorities of the Illinois EPA, Illinois Department of Agriculture, Illinois Department of Natural Resources, U.S. Department of Agriculture's Natural Resources Conservation Service, U.S. Army Corps of Engineers, and The Nature Conservancy are described and illustrated at the website: <http://www.epa.state.il.us/water/unified-watershed-assessment/index.html>. In order to help farmers in adopting sound agricultural practices, The Illinois Council on Best Management Practices (C-BMP) was formed. The Council is a coalition of agribusiness and agricultural producer organizations with the support of the University of Illinois Extension and serves as a clearinghouse on current research to protect water quality in Illinois. The Council also provides information and support to local watershed groups to help implement sound water quality initiatives and can offer educational assistance and help facilitate the technical and financial resources needed to carry out water quality objectives. For more information on C-BMP contact Dr. George Czapar, Springfield Extension Center, P.O. Box 8199, Springfield, IL 62791, email: g-czapar@uiuc.edu.*

SECTION 4: SOURCE WATER PROTECTION PLAN OBJECTIVES

This section presents the Oakwood CWS's adherence to the requirements of Section 604.320 Source Water Protection Plan Objectives, which are:

The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.

4.1 Identified Concerns

The following concerns regarding the Oakwood CWS's source water were identified based on the source water assessment.

- Impacts of agricultural land use on the Oakwood CWS's source water, particularly bacteria and pesticides.
- Impacts of source water contamination on the Oakwood CWS's finished drinking water quality.
- Implications of removing existing and potential future contamination from the Oakwood CWS's source water to meet drinking water standards.
- Identifying and implementing effective programs and activities for protecting the Oakwood CWS's source water.

4.2 Objectives

Given the identified concerns, the Oakwood CWS developed the following SWPP objectives. These objectives provide a framework for the Oakwood CWS's source water protection activities. The specific activities that align with these objectives are outlined in Section 5 of this Plan.

I. Source Water Characterization / Protection Area Delineation

- A. Characterize the source water used by Oakwood CWS by identifying flowtimes to the Oakwood CWS surface water intake.

II. Potential Contaminant Source and Land Use Inventories

- A. Use local, state, and federal data resources to identify the location and nature of potential sources of contamination and associated land uses within the source water protection areas of the Oakwood CWS surface water intake.

III. Source Water Protection Management

- A. Public Engagement - Engage the community at-large and provide additional opportunities for source water protection stakeholders.
- B. Source Water Monitoring - Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.
- C. Contingency Planning - Maintain and update existing emergency response plans, particularly as it pertains to source water contamination.
- D. Planning - Actively review, update, and improve all aspects of Oakwood CWS's Source Water Protection Plan.

SECTION 5: ACTION PLAN

This section presents the System's adherence to the requirements of Section 604.325 Action Plan, which are:

In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;*
- b) the community water supply's schedule for implementing projects, programs and activities;*
- c) an identification of the necessary resources to implement the plan; and*
- d) an identification of the potential problems with and obstacles to implementing the plan.*

5.1 Projects, Programs, and Activities to Meet Objectives

To meet its Source Water Protection Objectives, the System will continue its current initiatives (as described in Section 3.8), as well as implement the projects, programs, and activities identified below. The entire Action Plan including objectives; projects, programs, and activities; schedule; necessary resources; and potential problems is presented in Table No. 5-1.

5.2 Schedule for Implementing Projects, Programs, and Activities

The schedule for implementing the projects, programs, and activities of the System's Source Water Protection Program is presented in Table No. 5-1.

5.3 Identification of Necessary Resources to Implement the Plan

The resources necessary for implementation of the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.

5.4 Identification of Potential Problems and Obstacles in Implementing the Plan

The potential problems and obstacles in implementing the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.

PRAIRIE PATH WATER COMPANY - OAKWOOD CWS SOURCE WATER PROTECTION PLAN (July 2024)

Category	Objective	Projects, Programs, and Activities	Schedule	Necessary Resources	Potential Problems
I. Source Water Characterization / Protection Area Delineation	A. Characterize the source water used by Oakwood CWS by identifying flowtimes to the Oakwood CWS surface water intake.	1. Review flowtimes and refine/update as necessary.	July 2029	Staff time	Limited data
II. Potential Contaminant Source and Land Use Inventories	A. Use local, state, and federal data resources to identify the location and nature of potential sources of contamination and associated land uses within the source water protection areas of Oakwood CWS surface water intake.	1. PPWC staff conduct visual surveys of activities within Protection Zone A.	Monthly	Staff time	None
		2. Coordinate with jurisdictional authorities to monitor land use changes within the protection areas.	July 2029	Staff time	Cooperation of jurisdictions
		3. Establish program to engage local Fire Protection Authorities.	July 2029	Staff Time	Interest of jurisdictions
III. Source Water Protection Management	A. Public Engagement - Engage the community at-large and provide additional opportunities for source water protection stakeholders.	1. Public Awareness - Develop and distribute information regarding PPWC source water, including: ● Newsletters ● Annual Water Quality Report ● Bill stuffers / Specialty mailers	Annually	Staff time	None -WQ Report must be updated for compliance
		2. Public Education - Educate community and property owners on how they can participate in PPWC's source water protection efforts.	July 2029	Staff time	Stakeholder interest
		3. Public Involvement - Consider creating local source water protection group to promote communication and collaboration on all matters pertaining to source water protection.	July 2029	Staff time	Stakeholder interest
	B. Source Water Monitoring - Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.	1. Monitor known and emerging contaminants, including the collection of source water samples for current and emerging contaminants and the analysis of these data for anomalies and trends.	As required	Staff time	None - Must be completed for compliance
	C. Contingency Planning - Maintain and update existing emergency response plans, particularly as it pertains to groundwater contamination.	1. Update Emergency Response Plan (ERP)	Annually	Staff time	Competing priorities
		1. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.	July 2029	Staff time	Competing priorities
		2. Support County Water Sustainability efforts (if applicable).	July 2029	Staff time	Existence of such programs
3. Periodic review and updating of the Source Water Protection Plan Vision statement, Source Water Assessment, Objectives, and Action Plan with input from external stakeholders.		July 2029	Staff time / Consultant	None -required for compliance	
F. Planning - Actively review, update, and improve all aspects of Oakwood CWS's Source Water Protection Plan.					

APPENDIX A

Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan

TITLE 35: ENVIRONMENTAL PROTECTION
SUBTITLE F: PUBLIC WATER SUPPLIES
CHAPTER I: POLLUTION CONTROL BOARD

PART 604
DESIGN, OPERATION AND MAINTENANCE CRITERIA

SUBPART C: SOURCE WATER PROTECTION PLAN

Section 604.300 Purpose

The purpose of the following requirements is to facilitate protection of source water quality and quantity.

Section 604.305 Source Water Protection Plan Requirement and Contents

Each community water supply that treats surface or groundwater as a primary or emergency supply of water must develop a source water protection plan that contains the following minimum elements:

- a) a vision statement as set forth in Section 604.310;
- b) a source water assessment as set forth in Section 604.315;
- c) the objectives set forth in Section 604.320; and
- d) an action plan as set forth in Section 604.325.

Section 604.310 Vision Statement

The vision statement must include the following:

- a) the community water supply's policy and commitment to protecting source water;
- b) an explanation of the community water supply's resources to protect source water;
- c) an explanation of the barriers to protecting source water; and
- d) the names of the individuals who developed the vision statement.

Section 604.315 Source Water Assessment

- a) The source water assessment must contain the following information:
 - 1) statement of the importance of the source water;

- 2) a list of water supplies that obtain water from this community water supply;
 - 3) delineation of all sources of water used by the community water supply, including:
 - A) for surface water, description of the watershed, map of the watershed, and intake locations;
 - B) for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well;
 - 4) a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:
 - A) when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and
 - B) the certified laboratory's results;
 - 5) a report on the quality of the finished water;
 - 6) identification of potential sources of contamination to the source water;
 - 7) analysis of the source water's susceptibility to contamination; and
 - 8) explanation of the community water supply's efforts to protect its source water.
- b) Upon request, the Agency will provide technical assistance to a community water supply in conducting the source water assessment.
- b) A community water supply may use a Source Water Assessment Program Fact Sheet prepared by the Agency to fulfill the requirements of this Section.

Section 604.320 Source Water Protection Plan Objectives

The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water

assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.

Section 604.325 Action Plan

In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;
- c) the community water supply's schedule for implementing projects, programs and activities;
- c) an identification of the necessary resources to implement the plan; and
- d) an identification of the potential problems with and obstacles to implementing the plan.

Section 604.330 Submission

- a) A community water supply that first commenced construction after July 26, 2019, must develop and submit a source water protection plan simultaneously with the construction permit application.
- b) A community water supply in existence as of July 26, 2019, must develop and submit to the Agency for approval a source water protection plan within the following time frame after July 26, 2019:
 - 1) within 3 years, for a community water supply serving a population greater than 50,000 persons;
 - 2) within 4 years, for a community water supply serving a population of greater than 3,000 but less than or equal to 49,999 persons; or
 - 3) within 5 years, for a community water supply serving a population of less than or equal to 2,999 persons.
- d) An existing community water supply that anticipates using a new source of water for its supply must develop and submit a revised source water protection plan simultaneously with the construction permit application.

Section 604.335 Agency Approval

The Agency, not later than 45 days after the receipt of the source water protection plan, will either approve or disapprove the plan. If the Agency takes no action within the 45 days, the community water supply may deem the plan approved. A community water supply may waive the requirement that the Agency take an action within the 45 days by so advising the Agency in writing.

Section 604.340 Evaluation and Revision

The community water supply must review, and revise as necessary, its source water protection plan no less frequently than every five years. If the community water supply revises its source water protection plan, it must submit the plan to the Agency for approval under Section 604.335.

APPENDIX B

Representative Source Water Quality Analytical Lab Reports

Drinking Water Branch

Chem/Rad Sample Results

[Return
Links](#)

[Chem/Rad
Samples](#)

[Analyte
List](#)

[Water
System
Detail](#)

[Water
Systems](#)

[Water
System
Search](#)

[County
Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY- OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	GE02831-01	Collection Date :	05-11-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	26 UG/L	01-01-2023	12-31-2023
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1010	BARIUM	200.8			0	37 UG/L	01-01-2023	12-31-2023
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1017	CHLORIDE	300.0			0	43 MG/L	01-01-2023	12-31-2023
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2023	12-31-2023
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2023	12-31-2023
1025	FLUORIDE	4500F-C			0	0.62 MG/L	01-01-2023	12-31-2023
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2023	12-31-2023
1031	MAGNESIUM	200.7			0	29 MG/L		
1032	MANGANESE	200.8			0	10 UG/L	01-01-2023	12-31-2023
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2023	12-31-2023
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2023	12-31-2023
1045	SELENIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1052	SODIUM	200.7			0	20 MG/L	01-01-2023	12-31-2023
1055	SULFATE	300.0			0	24 MG/L	01-01-2023	12-31-2023
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2023	12-31-2023
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2023	12-31-2023
1915	HARDNESS, TOTAL (AS CACO3)	2340B			0	230 MG/L	01-01-2023	12-31-2023
1919	CALCIUM	200.7			0	46 MG/L	01-01-2023	12-31-2023
1927	ALKALINITY, TOTAL	2320B			0	180 MG/L	01-01-2023	12-31-2023
1930	TDS	2540C			0	270 MG/L	01-01-2023	12-31-2023
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2023	12-31-2023
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2023	12-31-2023
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2023	12-31-2023
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2023	12-31-2023
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2023	12-31-2023
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2251	METHYL TERT-BUTYL	524.2	Y	MRL	0.5 UG/L			

	ETHER							
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2023	12-31-2023
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2023	12-31-2023
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2023	12-31-2023
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025

Total Number of Records Fetched = 62

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	FD03594-01	Collection Date :	04-19-2022

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	43 UG/L	01-01-2022	12-31-2022
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2022	12-31-2022
1010	BARIUM	200.8			0	31 UG/L	01-01-2022	12-31-2022
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2022	12-31-2022
1017	CHLORIDE	300.0			0	44 MG/L	01-01-2022	12-31-2022
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2022	12-31-2022
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2022	12-31-2022
1025	FLUORIDE	4500F-C			0	0.703 MG/L	01-01-2022	12-31-2022
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2022	12-31-2022
1031	MAGNESIUM	200.7			0	27 MG/L		
1032	MANGANESE	200.8			0	2.9 UG/L	01-01-2022	12-31-2022
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2022	12-31-2022
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2022	12-31-2022
1045	SELENIUM	200.8	Y	MRL	1 UG/L		01-01-2022	12-31-2022
1052	SODIUM	200.7			0	17 MG/L	01-01-2022	12-31-2022
1055	SULFATE	300.0			0	21 MG/L	01-01-2022	12-31-2022
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2022	12-31-2022
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2022	12-31-2022
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2022	12-31-2022
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2022	12-31-2022
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2022	12-31-2022
1919	CALCIUM	200.7			0	48 MG/L	01-01-2022	12-31-2022
1927	ALKALINITY, TOTAL	2320B			0	160 MG/L	01-01-2022	12-31-2022
1930	TDS	2540C			0	280 MG/L	01-01-2022	12-31-2022
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2022	12-31-2022
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2022	12-31-2022
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2022	12-31-2022
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2022	12-31-2022
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2022	12-31-2022
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2022	12-31-2022
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2022	12-31-2022
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2022	06-30-2022
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2022	12-31-2022
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2022	12-31-2022
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2022	12-31-2022
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2022	06-30-2022
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2022	12-31-2022
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2022	12-31-2022
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2022	12-31-2022
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2022	12-31-2022

2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2022	12-31-2022
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2022	12-31-2022
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2022	12-31-2022
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L		01-01-2022	12-31-2022
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2022	12-31-2022
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2022	12-31-2022
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2022	12-31-2022
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2022	12-31-2022

Total Number of Records Fetched = 52

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	ED01159-01	Collection Date :	04-06-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	40 UG/L	01-01-2021	12-31-2021
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1010	BARIUM	200.8			0	28 UG/L	01-01-2021	12-31-2021
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1017	CHLORIDE	300.0			0	53 MG/L	01-01-2021	12-31-2021
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2021	12-31-2021
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2021	12-31-2021
1025	FLUORIDE	4500F-C			0	0.67 MG/L	01-01-2021	12-31-2021
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2021	12-31-2021
1031	MAGNESIUM	200.7			0	26 MG/L		
1032	MANGANESE	200.8			0	3.5 UG/L	01-01-2021	12-31-2021
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2021	12-31-2021
1045	SELENIUM	200.8			0	1.3 UG/L	01-01-2021	12-31-2021
1052	SODIUM	200.7			0	24 MG/L	01-01-2021	12-31-2021
1055	SULFATE	300.0			0	23 MG/L	01-01-2021	12-31-2021
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2021	12-31-2021
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2021	12-31-2021
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	210 MG/L	01-01-2021	12-31-2021
1919	CALCIUM	200.7			0	40 MG/L	01-01-2021	12-31-2021
1927	ALKALINITY, TOTAL	2320B			0	130 MG/L	01-01-2021	12-31-2021
1930	TDS	2540C			0	270 MG/L	01-01-2021	12-31-2021
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2021	12-31-2021
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2021	12-31-2021
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2021	12-31-2021
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2021	12-31-2021
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2021	06-30-2021
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2021	12-31-2021
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2021	12-31-2021
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2021	06-30-2021
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2021	12-31-2021
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2021	12-31-2021
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2021	12-31-2021
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			

2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2021	12-31-2021
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2021	12-31-2021
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L		01-01-2021	12-31-2021
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2021	12-31-2021
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2021	12-31-2021
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021

Total Number of Records Fetched = 55

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	0041825-01	Collection Date :	04-07-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	20 UG/L	01-01-2020	12-31-2020
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1010	BARIUM	200.8			0	39 UG/L	01-01-2020	12-31-2020
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1017	CHLORIDE	300.0			0	39 MG/L	01-01-2020	12-31-2020
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2020
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2020
1025	FLUORIDE	4500F-C			0	0.663 MG/L	01-01-2020	12-31-2020
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2020	12-31-2020
1031	MAGNESIUM	200.7			0	29 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2020
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2020
1045	SELENIUM	200.8			0	1.1 UG/L	01-01-2020	12-31-2020
1052	SODIUM	200.7			0	20 MG/L	01-01-2020	12-31-2020
1055	SULFATE	300.0			0	25 MG/L	01-01-2020	12-31-2020
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2020	12-31-2020
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2020	12-31-2020
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	270 MG/L	01-01-2020	12-31-2020
1919	CALCIUM	200.7			0	60 MG/L	01-01-2020	12-31-2020
1927	ALKALINITY, TOTAL	2320B			0	190 MG/L	01-01-2020	12-31-2020
1930	TDS	2540C			0	290 MG/L	01-01-2020	12-31-2020
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2020
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2020
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2020
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2020	06-30-2020
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2020
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2020
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2020
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2020	06-30-2020
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020

2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2020
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2020
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2020
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022

Total Number of Records Fetched = 82

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	9052035-01	Collection Date :	05-08-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1010	BARIUM	200.8			0	34 UG/L	01-01-2019	12-31-2019
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1017	CHLORIDE	300.0			0	32 MG/L	01-01-2019	12-31-2019
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2019	12-31-2019
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2019	12-31-2019
1025	FLUORIDE	4500F-C			0	0.718 MG/L	01-01-2019	12-31-2019
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2019	12-31-2019
1031	MAGNESIUM	200.7			0	26 MG/L		
1032	MANGANESE	200.8			0	4.8 UG/L	01-01-2019	12-31-2019
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2019	12-31-2019
1045	SELENIUM	200.8			0	2 UG/L	01-01-2019	12-31-2019
1052	SODIUM	200.7			0	15 MG/L	01-01-2019	12-31-2019
1055	SULFATE	300.0			0	21 MG/L	01-01-2019	12-31-2019
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2019	12-31-2019
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2019	12-31-2019
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2019	12-31-2019
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2019	12-31-2019
1919	CALCIUM	200.7			0	48 MG/L	01-01-2019	12-31-2019
1927	ALKALINITY, TOTAL	2320B			0	150 MG/L	01-01-2019	12-31-2019
1930	TDS	2540C			0	260 MG/L	01-01-2019	12-31-2019
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2019	12-31-2019
2032	DIQUAT	549.2	Y	MRL	2 UG/L			
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2019	12-31-2019
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2019	12-31-2019
2036	OXAMYL	531.1	Y	MRL	2 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2019	06-30-2019
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2019	12-31-2019
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2019	12-31-2019
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2019	06-30-2019
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2019	12-31-2019

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2019	12-31-2019
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2019	12-31-2019
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2019	12-31-2019
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2019	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2019	12-31-2019
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2019	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019

Total Number of Records Fetched = 59

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	8042672-01	Collection Date :	04-12-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1010	BARIUM	200.8			0	34 UG/L	01-01-2018	12-31-2018
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1017	CHLORIDE	300.0			0	44 MG/L	01-01-2018	12-31-2018
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2018	12-31-2018
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2018	12-31-2018
1025	FLUORIDE	4500F-C			0	0.64 MG/L	01-01-2018	12-31-2018
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2018	12-31-2018
1031	MAGNESIUM	200.7			0	30 MG/L		
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2018	12-31-2018
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2018	12-31-2018
1052	SODIUM	200.7			0	22 MG/L	01-01-2018	12-31-2018
1055	SULFATE	300.0			0	30 MG/L	01-01-2018	12-31-2018
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2018	12-31-2018
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2018	12-31-2018
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2018	12-31-2018
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	250 MG/L	01-01-2018	12-31-2018
1919	CALCIUM	200.7	N		0	53 MG/L	01-01-2018	12-31-2018
1927	ALKALINITY, TOTAL	2320B			0	180 MG/L	01-01-2018	12-31-2018
1930	TDS	2540C			0	250 MG/L	01-01-2018	12-31-2018
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2018	12-31-2018
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2018	12-31-2018
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2018	12-31-2018
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2018	12-31-2018
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2018	12-31-2018
2037	SIMAZINE	525.2			0	0.35 UG/L	01-01-2018	12-31-2018
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2018	12-31-2018
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2018	12-31-2018
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2018	12-31-2018
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2018	06-30-2018
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2018	12-31-2018

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2018	12-31-2018
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2018	12-31-2018
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2018	12-31-2018
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2018	12-31-2018
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2018	12-31-2018
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2018	12-31-2018
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018

Total Number of Records Fetched = 59

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7051467-01	Collection Date :	05-08-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1010	BARIUM	200.8			0	27 UG/L	01-01-2017	12-31-2017
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1017	CHLORIDE	300.0			0	34 MG/L	01-01-2017	12-31-2017
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2017	12-31-2017
1025	FLUORIDE	4500F-C			0	0.746 MG/L	01-01-2017	12-31-2017
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2017	12-31-2017
1031	MAGNESIUM	200.7			0	27 MG/L		
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1052	SODIUM	200.7			0	21 MG/L	01-01-2017	12-31-2017
1055	SULFATE	300.0			0	48 MG/L	01-01-2017	12-31-2017
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2017	12-31-2017
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2017	12-31-2017
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2017	12-31-2017
1919	CALCIUM	200.7	N		0	46 MG/L	01-01-2017	12-31-2017
1927	ALKALINITY, TOTAL	2320B			0	140 MG/L	01-01-2017	12-31-2017
1930	TDS	2540C			0	300 MG/L	01-01-2017	12-31-2017
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2017	12-31-2017
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2017	12-31-2017
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2017	12-31-2017
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2017	12-31-2017
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2017
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2017	12-31-2017
2050	ATRAZINE	525.2			0	0.51 UG/L	04-01-2017	06-30-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2017	12-31-2017

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2017	12-31-2017
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2017	12-31-2017
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019

Total Number of Records Fetched = 79

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	6053044-01	Collection Date :	05-18-2016

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1010	BARIUM	200.8			0	38 UG/L	01-01-2016	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2016	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2016	12-31-2016
1025	FLUORIDE	4500F-C			0	0.574 MG/L	01-01-2016	12-31-2016
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2016	12-31-2016
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2016	12-31-2016
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2016	12-31-2016
1052	SODIUM	200.7			0	18 MG/L	01-01-2016	12-31-2016
1055	SULFATE	300.0			0	49 MG/L	01-01-2016	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2016	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2016	12-31-2016
1095	ZINC	200.8			0	10 UG/L	01-01-2016	12-31-2016
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2016	12-31-2016
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2016	12-31-2016
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2016	12-31-2016
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2016	12-31-2016
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2016	12-31-2016
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2016	12-31-2016
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2016	12-31-2016
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2016	12-31-2016
2050	ATRAZINE	525.2			0	0.49 UG/L	01-01-2016	12-31-2016
2051	LESSO	525.2	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2016	12-31-2016
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2016	12-31-2016
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2016	12-31-2016
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016

2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2016	12-31-2016
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2016	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2016	12-31-2016
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2016	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016

Total Number of Records Fetched = 52

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	5041752-01	Collection Date :	04-08-2015

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1010	BARIUM	200.8			0	27 UG/L	01-01-2015	12-31-2015
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2015	12-31-2015
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2015	12-31-2015
1025	FLUORIDE	4500F-C			0	1.26 MG/L	01-01-2015	12-31-2015
1028	IRON	200.7			0	0.011 MG/L	01-01-2015	12-31-2015
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2015	12-31-2015
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2015	12-31-2015
1052	SODIUM	200.7			0	25 MG/L	01-01-2015	12-31-2015
1055	SULFATE	300.0			0	51 MG/L	01-01-2015	12-31-2015
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2015	12-31-2015
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2015	12-31-2015
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2015	12-31-2015
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2015	12-31-2015
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2015	12-31-2015
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2015	12-31-2015
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2015	12-31-2015
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2015	12-31-2015
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2015	12-31-2015
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2015	12-31-2015
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2015	12-31-2015
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2015	12-31-2015
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2015	12-31-2015
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2015	12-31-2015
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2015	12-31-2015
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015

2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2015	12-31-2015
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2015	12-31-2015
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2015	12-31-2015
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2015	12-31-2015
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015

Total Number of Records Fetched = 53

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	4043646-01	Collection Date :	04-23-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1010	BARIUM	200.8			0	30 UG/L	01-01-2014	12-31-2014
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2014
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2014
1025	FLUORIDE	4500F-C			0	1.02 MG/L	01-01-2014	12-31-2014
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2014	12-31-2014
1032	MANGANESE	200.8			0	1.5 UG/L	01-01-2014	12-31-2014
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1052	SODIUM	200.7			0	26 MG/L	01-01-2014	12-31-2014
1055	SULFATE	300.0			0	94 MG/L	01-01-2014	12-31-2014
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2014
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2014
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2014	12-31-2014
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2014
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2014
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2014	12-31-2014
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2014	12-31-2014
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2014	12-31-2014
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2014
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2014
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2014	12-31-2014
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2014	12-31-2014
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014

2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2014
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2014
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

Total Number of Records Fetched = 78

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	3040795-01	Collection Date :	04-03-2013

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1010	BARIUM	200.8			0	36 UG/L	01-01-2013	12-31-2013
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2013	12-31-2013
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2013	12-31-2013
1025	FLUORIDE	4500F-C			0	1.03 MG/L	01-01-2013	12-31-2013
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2013	12-31-2013
1032	MANGANESE	200.8			0	1.3 UG/L	01-01-2013	12-31-2013
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2013	12-31-2013
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2013	12-31-2013
1052	SODIUM	200.7			0	18 MG/L	01-01-2013	12-31-2013
1055	SULFATE	300.0			0	44 MG/L	01-01-2013	12-31-2013
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2013	12-31-2013
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2013	12-31-2013
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2013	12-31-2013
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2013	12-31-2013
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2013	12-31-2013
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2013	12-31-2013
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2013	12-31-2013
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2013	12-31-2013
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2013	12-31-2013
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2013	12-31-2013
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2013	12-31-2013
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2013	12-31-2013
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2013	06-30-2013
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2013	12-31-2013
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2013	12-31-2013

2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2013	12-31-2013
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2013	12-31-2013
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2013	12-31-2013
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2013	12-31-2013
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2013	12-31-2013
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013

Total Number of Records Fetched = 56

Drinking Water Branch

Chem/Rad Sample Results

Return Links

[Chem/Rad
Samples](#)

[Analyte List](#)

[Water System
Detail](#)

[Water Systems](#)

[Water System
Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	5020688-01	Collection Date :	02-04-2015

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
4010	COMBINED RADIUM (-226 & -228)	null	null		null null	0.507 PCI/L	01-01-2014	12-31-2019
4020	RADIUM-226	903.1			0	0.0639 PCI/L	01-01-2014	12-31-2019
4030	RADIUM-228	904.0			0	0.443 PCI/L	01-01-2014	12-31-2019
4109	GROSS ALPHA PARTICLE ACTIVITY	900			0	0.503 PCI/L	01-01-2014	12-31-2019

Total Number of Records Fetched = 4

Drinking Water Branch

Chem/Rad Sample Results

Return Links

[Chem/Rad
Samples](#)

[Analyte List](#)

[Water System
Detail](#)

[Water Systems](#)

[Water System
Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	GA00820-01	Collection Date :	01-04-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
4010	COMBINED RADIUM (-226 & -228)	null	Y	MRL	0.696 PCI/L		01-01-2017	12-31-2025
4020	RADIUM-226	903.1	Y	MRL	0.696 PCI/L		01-01-2017	12-31-2025
4030	RADIUM-228	904.0	Y	MRL	0.567 PCI/L		01-01-2017	12-31-2025
4109	GROSS ALPHA PARTICLE ACTIVITY	900.0	Y	MRL	2.76 PCI/L		01-01-2017	12-31-2025

Total Number of Records Fetched = 4

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	GH03917-01	Collection Date :	08-16-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		07-01-2023	09-30-2023
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		07-01-2023	09-30-2023
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 18

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	GF03054-01	Collection Date :	06-14-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2023	12-31-2023
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2023	12-31-2023
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2023	12-31-2023
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2023	12-31-2023
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2023	06-30-2023
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2023	12-31-2023
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2023
2050	ATRAZINE	525.2			0	0.78 UG/L	04-01-2023	06-30-2023
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2023	12-31-2023
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2023	12-31-2023
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2023	12-31-2023
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2023	12-31-2023
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2023	12-31-2023
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2023	12-31-2023
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L		01-01-2023	12-31-2023
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2023	12-31-2023

Total Number of Records Fetched = 18

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	EK00768-01	Collection Date :	11-02-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		10-01-2021	12-31-2021
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		10-01-2021	12-31-2021
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	EK00768-01	Collection Date :	11-02-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		10-01-2021	12-31-2021
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		10-01-2021	12-31-2021
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	ED01159-01	Collection Date :	04-06-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	40 UG/L	01-01-2021	12-31-2021
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1010	BARIUM	200.8			0	28 UG/L	01-01-2021	12-31-2021
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1017	CHLORIDE	300.0			0	53 MG/L	01-01-2021	12-31-2021
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2021	12-31-2021
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2021	12-31-2021
1025	FLUORIDE	4500F-C			0	0.67 MG/L	01-01-2021	12-31-2021
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2021	12-31-2021
1031	MAGNESIUM	200.7			0	26 MG/L		
1032	MANGANESE	200.8			0	3.5 UG/L	01-01-2021	12-31-2021
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2021	12-31-2021
1045	SELENIUM	200.8			0	1.3 UG/L	01-01-2021	12-31-2021
1052	SODIUM	200.7			0	24 MG/L	01-01-2021	12-31-2021
1055	SULFATE	300.0			0	23 MG/L	01-01-2021	12-31-2021
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2021	12-31-2021
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2021	12-31-2021
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2021	12-31-2021
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	210 MG/L	01-01-2021	12-31-2021
1919	CALCIUM	200.7			0	40 MG/L	01-01-2021	12-31-2021
1927	ALKALINITY, TOTAL	2320B			0	130 MG/L	01-01-2021	12-31-2021
1930	TDS	2540C			0	270 MG/L	01-01-2021	12-31-2021
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2021	12-31-2021
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2021	12-31-2021
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2021	12-31-2021
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2021	12-31-2021
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2021	06-30-2021
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2021	12-31-2021
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2021	12-31-2021
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2021	06-30-2021
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2021	12-31-2021
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2021	12-31-2021
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2021	12-31-2021
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			

2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2021	12-31-2021
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2021	12-31-2021
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2021	12-31-2021
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.08 UG/L		01-01-2021	12-31-2021
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2021	12-31-2021
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2021	12-31-2021
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2021	12-31-2021
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2021	12-31-2021

Total Number of Records Fetched = 55

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	0081615-01	Collection Date :	08-05-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		07-01-2020	09-30-2020
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2			0	0.31 UG/L	07-01-2020	09-30-2020
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	0041825-01	Collection Date :	04-07-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	20 UG/L	01-01-2020	12-31-2020
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1010	BARIUM	200.8			0	39 UG/L	01-01-2020	12-31-2020
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1017	CHLORIDE	300.0			0	39 MG/L	01-01-2020	12-31-2020
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2020
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2020
1025	FLUORIDE	4500F-C			0	0.663 MG/L	01-01-2020	12-31-2020
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2020	12-31-2020
1031	MAGNESIUM	200.7			0	29 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2020
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2020
1045	SELENIUM	200.8			0	1.1 UG/L	01-01-2020	12-31-2020
1052	SODIUM	200.7			0	20 MG/L	01-01-2020	12-31-2020
1055	SULFATE	300.0			0	25 MG/L	01-01-2020	12-31-2020
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2020	12-31-2020
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2020	12-31-2020
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	270 MG/L	01-01-2020	12-31-2020
1919	CALCIUM	200.7			0	60 MG/L	01-01-2020	12-31-2020
1927	ALKALINITY, TOTAL	2320B			0	190 MG/L	01-01-2020	12-31-2020
1930	TDS	2540C			0	290 MG/L	01-01-2020	12-31-2020
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2020
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2020
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2020
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2020	06-30-2020
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2020
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2020
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2020
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2020	06-30-2020
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020

2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2020
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2020
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2020
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022

Total Number of Records Fetched = 82

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	9052035-01	Collection Date :	05-08-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1010	BARIUM	200.8			0	34 UG/L	01-01-2019	12-31-2019
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1017	CHLORIDE	300.0			0	32 MG/L	01-01-2019	12-31-2019
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2019	12-31-2019
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2019	12-31-2019
1025	FLUORIDE	4500F-C			0	0.718 MG/L	01-01-2019	12-31-2019
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2019	12-31-2019
1031	MAGNESIUM	200.7			0	26 MG/L		
1032	MANGANESE	200.8			0	4.8 UG/L	01-01-2019	12-31-2019
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2019	12-31-2019
1045	SELENIUM	200.8			0	2 UG/L	01-01-2019	12-31-2019
1052	SODIUM	200.7			0	15 MG/L	01-01-2019	12-31-2019
1055	SULFATE	300.0			0	21 MG/L	01-01-2019	12-31-2019
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2019	12-31-2019
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2019	12-31-2019
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2019	12-31-2019
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2019	12-31-2019
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2019	12-31-2019
1919	CALCIUM	200.7			0	48 MG/L	01-01-2019	12-31-2019
1927	ALKALINITY, TOTAL	2320B			0	150 MG/L	01-01-2019	12-31-2019
1930	TDS	2540C			0	260 MG/L	01-01-2019	12-31-2019
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2019	12-31-2019
2032	DIQUAT	549.2	Y	MRL	2 UG/L			
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2019	12-31-2019
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2019	12-31-2019
2036	OXAMYL	531.1	Y	MRL	2 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2019	06-30-2019
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2019	12-31-2019
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2019	12-31-2019
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2019	06-30-2019
2051	ASSO	525.2	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2019	12-31-2019

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2019	12-31-2019
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2019	12-31-2019
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2019	12-31-2019
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2019	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2019	12-31-2019
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2019	12-31-2019
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2019	12-31-2019
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2019	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2019	12-31-2019

Total Number of Records Fetched = 59

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	8084118-01	Collection Date :	08-20-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		07-01-2018	09-30-2018
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2			0	0.33 UG/L	07-01-2018	09-30-2018
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	8042672-01	Collection Date :	04-12-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1010	BARIUM	200.8			0	34 UG/L	01-01-2018	12-31-2018
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1017	CHLORIDE	300.0			0	44 MG/L	01-01-2018	12-31-2018
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2018	12-31-2018
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2018	12-31-2018
1025	FLUORIDE	4500F-C			0	0.64 MG/L	01-01-2018	12-31-2018
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2018	12-31-2018
1031	MAGNESIUM	200.7			0	30 MG/L		
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2018	12-31-2018
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2018	12-31-2018
1052	SODIUM	200.7			0	22 MG/L	01-01-2018	12-31-2018
1055	SULFATE	300.0			0	30 MG/L	01-01-2018	12-31-2018
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2018	12-31-2018
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2018	12-31-2018
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2018	12-31-2018
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2018	12-31-2018
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	250 MG/L	01-01-2018	12-31-2018
1919	CALCIUM	200.7	N		0	53 MG/L	01-01-2018	12-31-2018
1927	ALKALINITY, TOTAL	2320B			0	180 MG/L	01-01-2018	12-31-2018
1930	TDS	2540C			0	250 MG/L	01-01-2018	12-31-2018
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2018	12-31-2018
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2018	12-31-2018
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2018	12-31-2018
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2018	12-31-2018
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2018	12-31-2018
2037	SIMAZINE	525.2			0	0.35 UG/L	01-01-2018	12-31-2018
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2018	12-31-2018
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2018	12-31-2018
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2018	12-31-2018
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2018	06-30-2018
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2018	12-31-2018

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2018	12-31-2018
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2018	12-31-2018
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2018	12-31-2018
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2018	12-31-2018
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2018	12-31-2018
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2018	12-31-2018
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2018	12-31-2018
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2018	12-31-2018
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2018	12-31-2018

Total Number of Records Fetched = 59

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	8032376-01	Collection Date :	03-13-2018

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2018	03-31-2018
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7103676-01	Collection Date :	10-18-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		10-01-2017	12-31-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7074084-01	Collection Date :	07-19-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2			0	0.9 UG/L	07-01-2017	09-30-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7051467-01	Collection Date :	05-08-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1010	BARIUM	200.8			0	27 UG/L	01-01-2017	12-31-2017
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1017	CHLORIDE	300.0			0	34 MG/L	01-01-2017	12-31-2017
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2017	12-31-2017
1025	FLUORIDE	4500F-C			0	0.746 MG/L	01-01-2017	12-31-2017
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2017	12-31-2017
1031	MAGNESIUM	200.7			0	27 MG/L		
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1052	SODIUM	200.7			0	21 MG/L	01-01-2017	12-31-2017
1055	SULFATE	300.0			0	48 MG/L	01-01-2017	12-31-2017
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2017	12-31-2017
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2017	12-31-2017
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2017	12-31-2017
1919	CALCIUM	200.7	N		0	46 MG/L	01-01-2017	12-31-2017
1927	ALKALINITY, TOTAL	2320B			0	140 MG/L	01-01-2017	12-31-2017
1930	TDS	2540C			0	300 MG/L	01-01-2017	12-31-2017
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2017	12-31-2017
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2017	12-31-2017
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2017	12-31-2017
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2017	12-31-2017
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2017
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2017	12-31-2017
2050	ATRAZINE	525.2			0	0.51 UG/L	04-01-2017	06-30-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2017	12-31-2017

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2017	12-31-2017
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2017	12-31-2017
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019

Total Number of Records Fetched = 79

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7013612-01	Collection Date :	01-25-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2017	03-31-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 20

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	6103446-01	Collection Date :	10-20-2016

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L			
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L			
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L			
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L			
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L			
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L			
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L			
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L			
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		10-01-2016	12-31-2016
2051	LASSO	525.2	Y	MRL	0.2 UG/L			
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L			
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L			
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L			
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L			
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L			
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L			

Total Number of Records Fetched = 19

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	6053044-01	Collection Date :	05-18-2016

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1010	BARIUM	200.8			0	38 UG/L	01-01-2016	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2016	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2016	12-31-2016
1025	FLUORIDE	4500F-C			0	0.574 MG/L	01-01-2016	12-31-2016
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2016	12-31-2016
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2016	12-31-2016
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2016	12-31-2016
1052	SODIUM	200.7			0	18 MG/L	01-01-2016	12-31-2016
1055	SULFATE	300.0			0	49 MG/L	01-01-2016	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2016	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2016	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2016	12-31-2016
1095	ZINC	200.8			0	10 UG/L	01-01-2016	12-31-2016
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2016	12-31-2016
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2016	12-31-2016
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2016	12-31-2016
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2016	12-31-2016
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2016	12-31-2016
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2016	12-31-2016
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2016	12-31-2016
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2016	12-31-2016
2050	ATRAZINE	525.2			0	0.49 UG/L	01-01-2016	12-31-2016
2051	LESSO	525.2	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2016	12-31-2016
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2016	12-31-2016
2070	DIELDIN	525.2	Y	MRL	0.05 UG/L		01-01-2016	12-31-2016
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2016	12-31-2016

2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2016	12-31-2016
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2016	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2016	12-31-2016
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2016	12-31-2016
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2016	12-31-2016
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2016	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2016	12-31-2016

Total Number of Records Fetched = 52

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	5041752-01	Collection Date :	04-08-2015

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1010	BARIUM	200.8			0	27 UG/L	01-01-2015	12-31-2015
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2015	12-31-2015
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2015	12-31-2015
1025	FLUORIDE	4500F-C			0	1.26 MG/L	01-01-2015	12-31-2015
1028	IRON	200.7			0	0.011 MG/L	01-01-2015	12-31-2015
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2015	12-31-2015
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2015	12-31-2015
1052	SODIUM	200.7			0	25 MG/L	01-01-2015	12-31-2015
1055	SULFATE	300.0			0	51 MG/L	01-01-2015	12-31-2015
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2015	12-31-2015
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2015	12-31-2015
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2015	12-31-2015
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2015	12-31-2015
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2015	12-31-2015
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2015	12-31-2015
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2015	12-31-2015
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2015	12-31-2015
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2015	12-31-2015
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2015	12-31-2015
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2015	12-31-2015
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2015	12-31-2015
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2015	12-31-2015
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2015	12-31-2015
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2015	12-31-2015
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2015	12-31-2015
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015

2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2015	12-31-2015
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2015	12-31-2015
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2015	12-31-2015
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2015	12-31-2015
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2015	12-31-2015
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2015	12-31-2015
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2015	12-31-2015

Total Number of Records Fetched = 53

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	4043646-01	Collection Date :	04-23-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1010	BARIUM	200.8			0	30 UG/L	01-01-2014	12-31-2014
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2014
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2014
1025	FLUORIDE	4500F-C			0	1.02 MG/L	01-01-2014	12-31-2014
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2014	12-31-2014
1032	MANGANESE	200.8			0	1.5 UG/L	01-01-2014	12-31-2014
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1052	SODIUM	200.7			0	26 MG/L	01-01-2014	12-31-2014
1055	SULFATE	300.0			0	94 MG/L	01-01-2014	12-31-2014
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2014
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2014
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2014	12-31-2014
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2014
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2014
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2014	12-31-2014
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2014	12-31-2014
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2014	12-31-2014
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2014
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2014
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2014	12-31-2014
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2014	12-31-2014
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014

2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2014
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2014
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

Total Number of Records Fetched = 78

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	3040795-01	Collection Date :	04-03-2013

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1010	BARIUM	200.8			0	36 UG/L	01-01-2013	12-31-2013
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2013	12-31-2013
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2013	12-31-2013
1025	FLUORIDE	4500F-C			0	1.03 MG/L	01-01-2013	12-31-2013
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2013	12-31-2013
1032	MANGANESE	200.8			0	1.3 UG/L	01-01-2013	12-31-2013
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2013	12-31-2013
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2013	12-31-2013
1052	SODIUM	200.7			0	18 MG/L	01-01-2013	12-31-2013
1055	SULFATE	300.0			0	44 MG/L	01-01-2013	12-31-2013
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2013	12-31-2013
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2013	12-31-2013
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2013	12-31-2013
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2013	12-31-2013
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2013	12-31-2013
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2013	12-31-2013
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2013	12-31-2013
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2013	12-31-2013
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2013	12-31-2013
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2013	12-31-2013
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2013	12-31-2013
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2013	12-31-2013
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2013	12-31-2013
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2013	06-30-2013
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2013	12-31-2013
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2013	12-31-2013

2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2013	12-31-2013
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2013	12-31-2013
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2013	12-31-2013
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2013	12-31-2013
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2013	12-31-2013
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2013	12-31-2013
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2013	12-31-2013
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2013	12-31-2013

Total Number of Records Fetched = 56

Drinking Water Branch

Chem/Rad Sample Results

[Return
Links](#)

[Chem/Rad
Samples](#)

[Analyte
List](#)

[Water
System
Detail](#)

[Water
Systems](#)

[Water
System
Search](#)

[County
Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY- OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	GE02831-01	Collection Date :	05-11-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	26 UG/L	01-01-2023	12-31-2023
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1010	BARIUM	200.8			0	37 UG/L	01-01-2023	12-31-2023
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1017	CHLORIDE	300.0			0	43 MG/L	01-01-2023	12-31-2023
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2023	12-31-2023
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2023	12-31-2023
1025	FLUORIDE	4500F-C			0	0.62 MG/L	01-01-2023	12-31-2023
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2023	12-31-2023
1031	MAGNESIUM	200.7			0	29 MG/L		
1032	MANGANESE	200.8			0	10 UG/L	01-01-2023	12-31-2023
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2023	12-31-2023
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2023	12-31-2023
1045	SELENIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1052	SODIUM	200.7			0	20 MG/L	01-01-2023	12-31-2023
1055	SULFATE	300.0			0	24 MG/L	01-01-2023	12-31-2023
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2023	12-31-2023
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2023
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2023	12-31-2023
1915	HARDNESS, TOTAL (AS CACO3)	2340B			0	230 MG/L	01-01-2023	12-31-2023
1919	CALCIUM	200.7			0	46 MG/L	01-01-2023	12-31-2023
1927	ALKALINITY, TOTAL	2320B			0	180 MG/L	01-01-2023	12-31-2023
1930	TDS	2540C			0	270 MG/L	01-01-2023	12-31-2023
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2023	12-31-2023
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2023	12-31-2023
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2023	12-31-2023
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2023	12-31-2023
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2023	12-31-2023
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2023	12-31-2023
2251	METHYL TERT-BUTYL	524.2	Y	MRL	0.5 UG/L			

	ETHER							
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2023	12-31-2023
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2023	12-31-2023
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2023	12-31-2023
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2023	12-31-2025

Total Number of Records Fetched = 62

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	0041825-01	Collection Date :	04-07-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8			0	20 UG/L	01-01-2020	12-31-2020
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1010	BARIUM	200.8			0	39 UG/L	01-01-2020	12-31-2020
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1017	CHLORIDE	300.0			0	39 MG/L	01-01-2020	12-31-2020
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2020
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2020
1025	FLUORIDE	4500F-C			0	0.663 MG/L	01-01-2020	12-31-2020
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2020	12-31-2020
1031	MAGNESIUM	200.7			0	29 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2020
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2020
1045	SELENIUM	200.8			0	1.1 UG/L	01-01-2020	12-31-2020
1052	SODIUM	200.7			0	20 MG/L	01-01-2020	12-31-2020
1055	SULFATE	300.0			0	25 MG/L	01-01-2020	12-31-2020
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2020	12-31-2020
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2020
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2020	12-31-2020
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	270 MG/L	01-01-2020	12-31-2020
1919	CALCIUM	200.7			0	60 MG/L	01-01-2020	12-31-2020
1927	ALKALINITY, TOTAL	2320B			0	190 MG/L	01-01-2020	12-31-2020
1930	TDS	2540C			0	290 MG/L	01-01-2020	12-31-2020
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2020
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2020
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2020
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2020
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		04-01-2020	06-30-2020
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2020
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2020
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2020
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		04-01-2020	06-30-2020
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020

2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2020
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2020
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2020
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2020
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2020
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2020
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2020
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2020
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2022

Total Number of Records Fetched = 82

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	7051467-01	Collection Date :	05-08-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1010	BARIUM	200.8			0	27 UG/L	01-01-2017	12-31-2017
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1017	CHLORIDE	300.0			0	34 MG/L	01-01-2017	12-31-2017
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2017	12-31-2017
1025	FLUORIDE	4500F-C			0	0.746 MG/L	01-01-2017	12-31-2017
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2017	12-31-2017
1031	MAGNESIUM	200.7			0	27 MG/L		
1032	MANGANESE	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2017
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1052	SODIUM	200.7			0	21 MG/L	01-01-2017	12-31-2017
1055	SULFATE	300.0			0	48 MG/L	01-01-2017	12-31-2017
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2017	12-31-2017
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2017
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2017
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2017	12-31-2017
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	230 MG/L	01-01-2017	12-31-2017
1919	CALCIUM	200.7	N		0	46 MG/L	01-01-2017	12-31-2017
1927	ALKALINITY, TOTAL	2320B			0	140 MG/L	01-01-2017	12-31-2017
1930	TDS	2540C			0	300 MG/L	01-01-2017	12-31-2017
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2017	12-31-2017
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2017	12-31-2017
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2017	12-31-2017
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2017	12-31-2017
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2017	12-31-2017
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2017
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2017	12-31-2017
2050	ATRAZINE	525.2			0	0.51 UG/L	04-01-2017	06-30-2017
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2017	12-31-2017

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2017	12-31-2017
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2017	12-31-2017
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2017	12-31-2017
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2017	12-31-2017
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2017	12-31-2017
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2017	12-31-2017
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2017	12-31-2017
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2017	12-31-2019

Total Number of Records Fetched = 79

Drinking Water Branch

Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

Water System No. :	IL1830600	Federal Type :	C
Water System Name :	PRAIRIE PATH WATER COMPANY-OAKWOOD	State Type :	C
Principal County Served :	VERMILION	Primary Source :	SW
Status :	A	Activity Date :	01-01-1939
Lab Sample No. :	4043646-01	Collection Date :	04-23-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1010	BARIUM	200.8			0	30 UG/L	01-01-2014	12-31-2014
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2014
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2014
1025	FLUORIDE	4500F-C			0	1.02 MG/L	01-01-2014	12-31-2014
1028	IRON	200.7	Y	MRL	0.01 MG/L		01-01-2014	12-31-2014
1032	MANGANESE	200.8			0	1.5 UG/L	01-01-2014	12-31-2014
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2014
1052	SODIUM	200.7			0	26 MG/L	01-01-2014	12-31-2014
1055	SULFATE	300.0			0	94 MG/L	01-01-2014	12-31-2014
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2014
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2014
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2014
1095	ZINC	200.8	Y	MRL	6 UG/L		01-01-2014	12-31-2014
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2014
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2014
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2014	12-31-2014
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2014
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2014	12-31-2014
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2014	12-31-2014
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2014
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2014
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2014	12-31-2014
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2014	12-31-2014
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014

2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2014
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2014
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2014
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2014
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2014
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2014
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2014
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

Total Number of Records Fetched = 78

December 8, 2021

Dear Valued Customer,

At Utility Services of Illinois, Inc. (USIL), we are committed to providing safe, reliable, cost-effective water and wastewater services. Part of this commitment includes continuous industry-standard testing of our processes and water supply to ensure the continuing health and safety of every community we serve.

The Illinois Environmental Protection Agency (Illinois EPA) recently tested our Oakwood water system for compounds known as Per- and Polyfluoroalkyl Substances (PFAS) as part of a statewide assessment of community water supplies.

PFAS and PFOS, two compounds for which neither the United States Environmental Protection Agency (US EPA) nor the Illinois EPA have established a Maximum Contaminant Level, are among a class of synthetic chemicals (known as perfluoroalkyl substances or PFAS) that accumulate over time in the environment and our bodies. Typical uses of PFAS include nonstick cookware, coatings on food packaging, fire-fighting foam, and many industrial applications. Studies are ongoing regarding the potential contaminative effect of these chemicals.

Illinois EPA has set Health Based Guidance Levels for PFOA at two parts per trillion (ppt) and PFOS at 14 ppt. The US EPA has set separate and combined Health Advisory Levels (HALs) for PFOA and PFOS at 70 ppt. The HAL is based on the US EPA's determination that a lifetime exposure can cause human health effects.

Illinois EPA testing has determined that one or more PFAS compounds were detected in our water supply. The Illinois EPA results were higher than their Health Based Guidance Levels. However, these results were below the US EPA's HALs.

Utility Services of Illinois, Inc. will continue to monitor your community's Health Based Guidance Levels and HALs. We look forward to the US EPA and Illinois EPA issuing clear and firm guidance that allows us to target our activity.

Results of the regular testing required by the US EPA and state regulatory agencies are made available to customers each year in Consumer Confidence Reports found on our website at www.uiwater.com/illinois. Also, for more information, please visit <https://www.epa.gov/pfas>.

Sincerely,



Steve Lubertozzi
President, Utility Services of Illinois, Inc.

Illinois EPA – PFAS Testing

Oakwood Water System

PFAS Analyte	All results reported in Nanograms per liter (ng/L)			
	IL EPA Health-Based Guidance Level	US EPA Health Advisory Level	TP 01 Collected 08/07/2021	TP 01 Collected 09/13/2021
Perfluorobutanesulfonic Acid (PFBS)	2,100	None	2.1	3.1
Perfluorohexanesulfonic Acid (PFHxS)	140	None	7.1	12
Perfluorononanoic Acid (PFNA)	21	None	ND	ND
Perfluorooctanesulfonic Acid (PFOS)	14	70	8.9	15
Perfluorooctanoic Acid (PFOA)	2	70	2.5	3.0
Perfluorohexanoic Acid (PFHxA)	560,000	None	2.8	4.4
Hexafluoropropylene oxide dimer acid (HFPO-DA)	560	None	ND	ND
Perfluoroheptanoic Acid (PFHpA)	None	None	4.2	4.6

- Health-based guidance level** – Illinois EPA has developed health-based guidance levels for the small number of PFAS for which there is appropriate information to do so. The health-based guidance levels are intended to be protective of all people consuming the water over a lifetime of exposure. It is important to understand that health-based guidance levels are not regulatory limits for drinking water. Rather, the health-based guidance levels are benchmarks against which sampling results are compared to determine if additional investigation or other response action is necessary.
- Lifetime Health Advisory Level (HAL)** – Health Advisory Level is the amount below which no harm is expected from these chemicals, according to the United States EPA. This health advisory level offers a margin of protection for all Americans throughout their life from adverse health effects resulting from exposure to PFOA and PFOS in drinking water. The HALs are calculated based on the drinking water intake of lactating women, who drink more water than other people and can pass these chemicals along to nursing infants through breastmilk. The EPA has set separate and combined HALs for PFOA and PFOS of 70 parts per trillion (ppt).
- Ng/L** – Nanograms per liter (ng/L) which equals Parts per trillion (ppt) – One part per trillion corresponds to one minute in 2,000,000 years, or a single penny in \$10,000,000,000.
- ND (No Detect)** - Laboratory analysis indicates that the constituent is not present. 2.0 ng/L is the minimum level the lab is reporting a detection for these parameters. The ND (No Detect) represented in the table is indicating there was no detection.

Oakwood Water System

Sampling Location	Date Sampled	All results reported as Nanograms per liter(ng/L)				Result Below Health Advisory Level?
		PFOS	PFOA	Combined PFOS + PFOA	EPA Health Advisory Level	
Surface Water	4/6/2020	8.3	2.2	10.5	70	Yes
<u>Resample Results:</u>						
Surface Water	9/23/2020	ND	2.3	2.3	70	Yes

- **PFOS** – Perfluorooctane Sulfonate
- **PFOA** – Perfluorooctanoic Acid
- **Health Advisory Level (HAL)** – To provide Americans, including the most sensitive populations, with a margin of protection from a lifetime of exposure to PFOA and PFOS from drinking water, EPA established the health advisory levels at 70 parts per trillion.
- **Ng/L** – Nanograms per liter(ng/L) which equals Parts per trillion (ppt) – One part per trillion corresponds to one minute in 2,000,000 years, or a single penny in \$10,000,000,000.
- **ND (No Detect)** - Laboratory analysis indicates that the constituent is not present. 2.0 ng/L is the minimum level the lab is reporting a detection for these parameters. The ND (No Detect) represented in the table is indicating there was no detection.

Oakwood IL Water System

PFAS Analyte	All results reported in Nanograms per liter (ng/L)							
	IL EPA Health-Based Guidance Level	US EPA Health Advisory Level	TP 01 Collected 4/28/2022	IN45102 Collected 4/28/2022	TP 01 Collected 07/27/2022	IN45102 Collected 07/27/2022	TP 01 Collected 10/19/2022	IN45102 Collected 10/19/2022
Perfluorobutanesulfonic Acid (PFBS)	2,100	None	None	None	3.0	3.6	3.9	3.8
Perfluorohexanesulfonic Acid (PFHxS)	140	None	6.4	8.6	5.1	5.5	6.4	4.5
Perfluorononanoic Acid (PFNA)	21	None	None	None	ND	2.1	ND	2.4
Perfluorooctanesulfonic Acid (PFOS)	14	70	7.5	19	11	18	10	12
Perfluorooctanoic Acid (PFOA)	2	70	2.1	2.3	3.6	4.4	3.5	4.6
Perfluorohexanoic Acid (PFHxA)	560,000	None	2.5	2.3	9.2	11	13	12
Hexafluoropropylene oxide dimer acid (HFPO-DA)	560	None	None	None	ND	ND	ND	ND
Perfluoroheptanoic Acid (PFHpA)	None	None	None	None	4.1	4.6	6.6	6.0

- Health-based guidance level** – Illinois EPA has developed health-based guidance levels for the small number of PFAS for which there is appropriate information to do so. The health-based guidance levels are intended to be protective of all people consuming the water over a lifetime of exposure. It is important to understand that health-based guidance levels are not regulatory limits for drinking water. Rather, the health-based guidance levels are benchmarks against which sampling results are compared to determine if additional investigation or other response action is necessary.
- Lifetime Health Advisory Level (HAL)** – Health Advisory Level is the amount below which no harm is expected from these chemicals, according to the United States EPA. This health advisory level offers a margin of protection for all Americans throughout their life from adverse health effects resulting from exposure to PFOA and PFOS in drinking water. The HALs are calculated based on the drinking water intake of lactating women, who drink more water than other people and can pass these chemicals along to nursing infants through breastmilk. The EPA has set separate and combined HALs for PFOA and PFOS of 70 parts per trillion (ppt).
- Ng/L** – Nanograms per liter(ng/L) which equals Parts per trillion (ppt) – One part per trillion corresponds to one minute in 2,000,000 years, or a single

penny in \$10,000,000,000.

- **ND (No Detect)** - Laboratory analysis indicates that the constituent is not present. 2.0 ng/L is the minimum level the lab is reporting a detection for these parameters. The ND (No Detect) represented in the table is indicating there was no detection.